

MAIN FLOOR

UPSTAIRS

11

NORTH


앞 CUSTOMER: QUINAULT INDIAN NATION LOCATION:

SHEET CONTENTS:

DESIGNED BY: PROJECT: NPW CARVING SHED DATE: 11/20/2012 SCALE 1:96 revision: A.1

QUINAULT ENGINEERING 114 WEST QUINAULT ST. TAHOLAH, WA 9858; ph (360) 276-8215 cell (360) 590-1866 WWW.QUINAULTINDIANNATION.COM

INDIAN

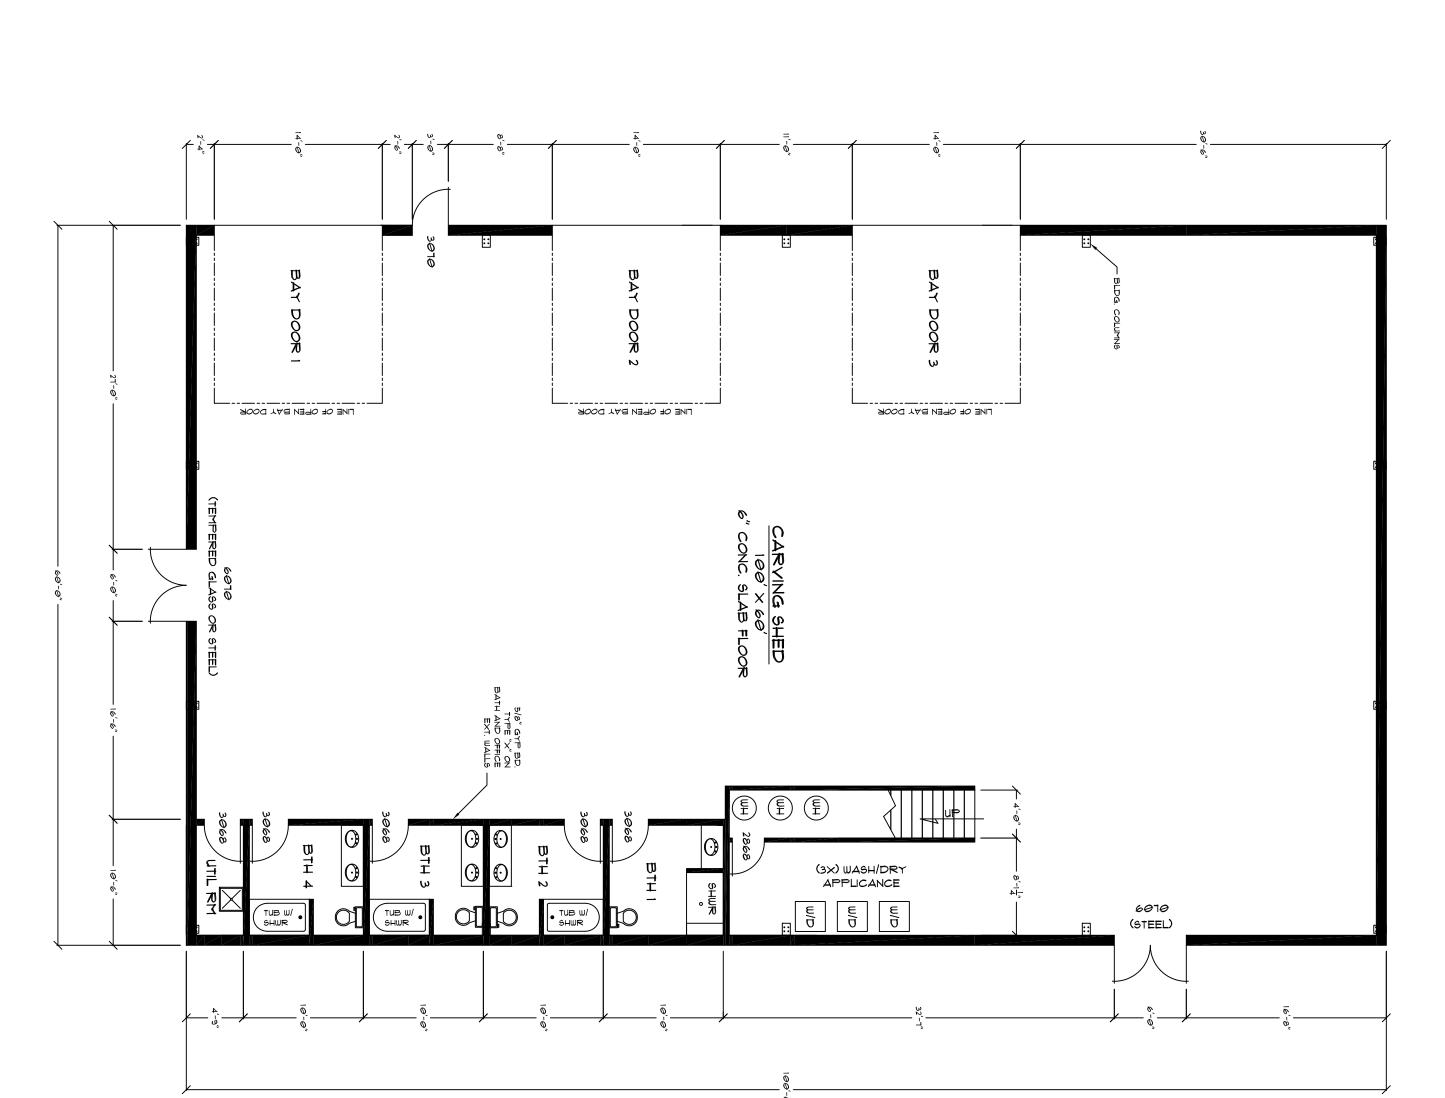

INTERIOR WALLS FRAMED WITH 2X6 @ 16 O/C UNLESS OTHERWISE NOTED.

CAULK AND COUNTER FLASH ALL EXT. OPENINGS: WINDOWS, DOORS, VENTS, ETC...

WHERE LOCAL WATER PRESSURE IS IN EXCESS OF 80 PSI, AN APPROVED PRESSURE REGULATOR PRECEDED BY AN ADEQUATE STRAINER SHALL BE INSTALLED.

RAISE DOORS UP 3/4" FOR TILE OR HARDWOOD FLOOR.

ASSUMED SOIL BEARING CAPACITY IS IS00 LBS/SQFT.

PRE-FABRICATED STEEL BUILDING TO BE DESIGNED BY APPLICABLE STATE LICENSED ENGINEER IN ACCORDANCE WITH REQUIREMENTS OF ALL LOCAL, STATE AND TRIBAL BUILDING CODES. ALL ENGINEERING AND DRAWING DATA SHALL BE MADE AVAILABLE TO THE BUILDING OFFICIAL UPON REQUEST AND BECOMES A PART OF THIS PLANSET.

 $\stackrel{\sim}{=}\stackrel{\circ}{=}\stackrel{\circ}{=}$ $\stackrel{\circ}{=}$ $\stackrel{\circ}{=}$

WATER HEATERS SHALL BE LOCATED BENEATH STAIRWELL AS REQUIRED AND COMPLY WITH ALL LOCAL CODES.

CONTRACTOR TO VERIFY SIZE AND LOCATION OF ALL OPENINGS IN FLOOR, ROOF AND WALLS AND COORDINATE WITH PLUMBING, ELECTRICAL AND MECHANICAL WORK.

ALL SIMPSON STRONG TIE CONNECTORS AND HANGERS TO BE INSTALLED WITH STRICT ACCORDANCE TO MANUF. INSTALLATION REQS. SEE INSTALL GUIDE S-INSTALLØS.

LUMBER SPECIFICATIONS:

• HF/DF NO. 1 FOR POSTS AND BEAMS
• HF/DF "STUD" FOR STUD WALL FRAMING
REINFORCING STEEL (REBAR) ASTM A-615 GRADE 60.

CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS, MATERIALS AND DIMENSIONS IN THE HELD.

4*0*3*0*×0 4*0*3*0*×0 4*0*3*0*×0 4*0*3*0*×0

REVISION HISTORY:

FLOOR PLAN

TAHOLAH, WA

NOTE:
FLOOR PLAN DIMENSIONS ARE TO FACE
OF FRAMING OR CENTERLINE OF OPENINGS,
TYP. AS SHOWN.