



FOR SERIAL INSTALLATION INSTALL 4\"/>

PIPE DETAIL FOR SERIAL INSTALLATION NOT TO SCALE

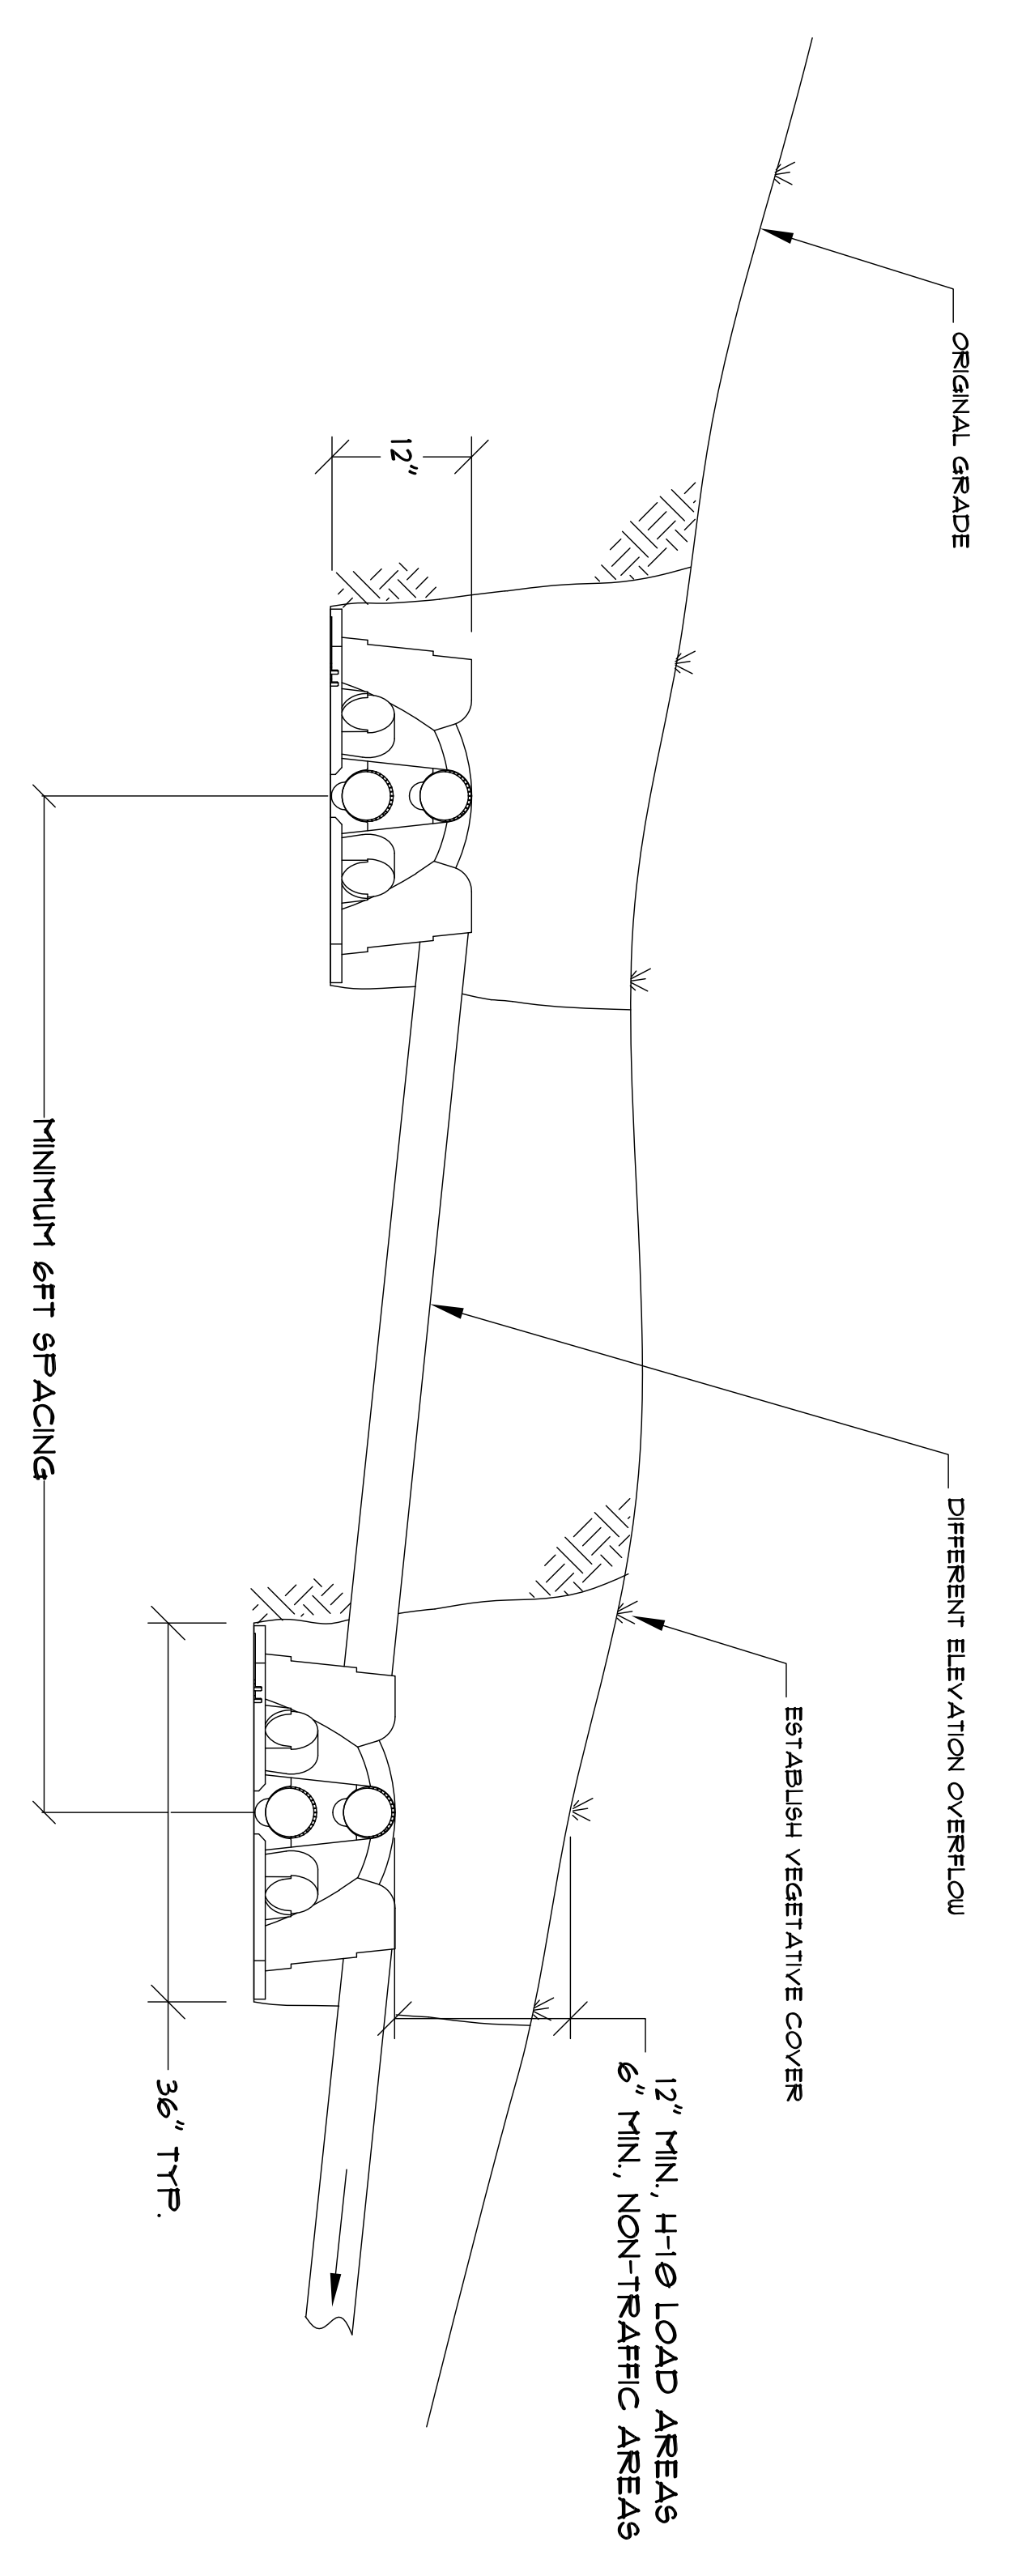

INFILTRATOR SYSTEMS INC. QUICK4 CHAMBER SLOPED SERIAL DISTRIBUTION DETAIL CROSS SECTION NOT TO SCALE

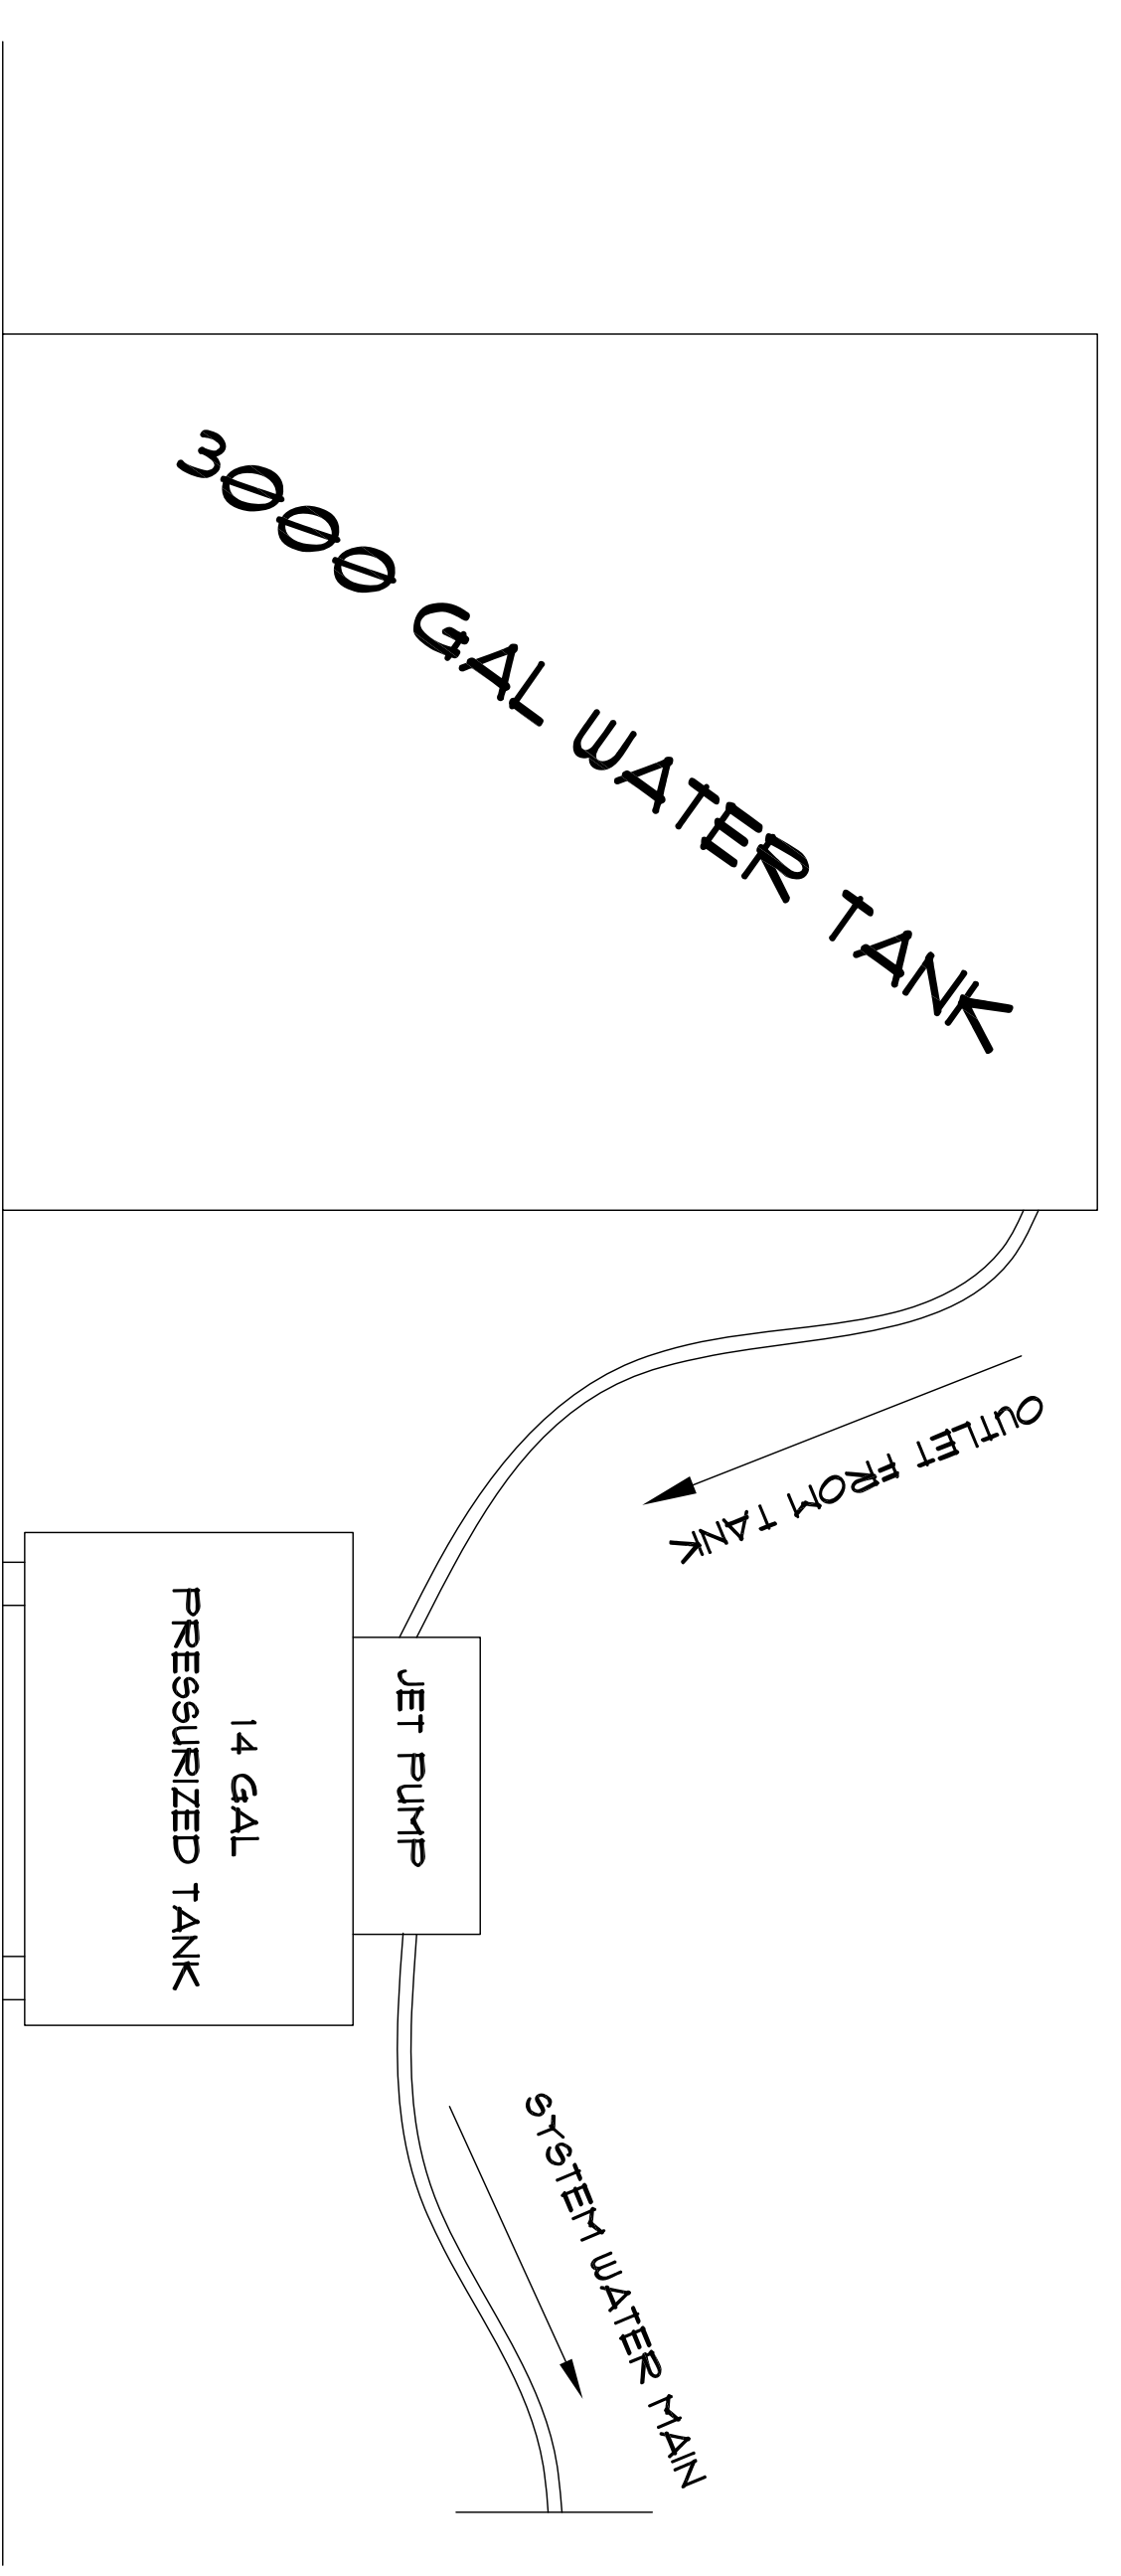

- SETUP OF POTABLE WATER SYSTEM FOR SITE. ALL COMPONENTS OF SYSTEM SHALL BE INSTALLED PER MANUFACTURERS INSTRUCTIONS. INSTALLATION MINIMUM REQUIREMENTS:
1. 3000 GAL DRINKING WATER GRADE TANK
  2. JET PUMP WITH PRESSURIZED VESSEL FOR WATER DISTRIBUTION
  3. SET JET PUMP SYSTEM TO 60-65 PSI
  4. INSTALLATION LOCATION TO BE DETERMINED BY PROJECT ENGINEER

SANITATION AND WATER DETAILS

NOT TO SCALE



**QUINALT ENGINEERING**  
 14851 QUINALT ST. TACOMA, WA 98502  
 PH (252) 274-8210 FAX (252) 393-1866  
 WWW.QUINALTENGINEERING.COM  
 10/12  
 10/12  
 ALL RIGHTS RESERVED. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM QUINALT ENGINEERING.

PROJECT:  
**CAONE JOURNEY 2013 AND BEYOND**  
 REVISION: A. 1

DESIGNED BY:  
 BJM  
 DATE:  
 8/30/2012

SHEET CONTENTS:  
**SANITATION AND WATER PLANS**

| REVISION HISTORY: |
|-------------------|
|                   |
|                   |
|                   |
|                   |

CUSTOMER:  
 QUINALT INDIAN NATION  
 LOCATION:  
 TAHOLAH, WA