



Wind Load Report - Effingham Duplex Wind Load

1. Site & Building Data

Roof Type: Gable
 Wind Speed (ult): 115 mph
 Exposure Category: B
 Enclosure Class: Enclosed
 Building Width (W): 28 ft.
 Building Length (L): 115 ft.
 Eave Height (h_e): 11.5 ft.
 Foundation Height (h_f): 0 ft.
 Roof Pitch: 5 /12
 Eave Overhang (OH_e): 1.5 ft.
 Gable Overhang (OH_g): 1 ft.

2. Parameters & Coefficients

Topographic Factor (K_{zt}): 1.0
 Directionality Factor (K_d): .85
 Roof Angle (θ): 22.62 deg.
 Mean Roof Height (h): 14.42 ft.
 Ridge Height (h_r): 17.33 ft.
 Pos. Internal Pressure (+GCpi): +0.18
 Neg. Internal Pressure (-GCpi): -0.18
 Velocity Pressure Exp. Coeff. (K_h): 0.70 @ z=h
 Velocity Pressure (q_h): 20.16 psf
 End Zone Width (a): 3.00 ft.
 Zone 2/2E Dist.: 14.00 ft.

3. Design Assumptions and Notes


Code Standard: ASCE 7-10
 Geometry: Regular-Shaped Bldg.
 Height Class: Low-Rise Building
 Notes: ASCE 7-16 Wind design category II is 106 MPH. ASCE 7-16 Wind design for category II is 115 MPH

4. Design Loads

Top Chord Dead Load: 7 psf
 Bottom Chord Dead Load: 15 psf
 Truss/Rafter Spacing: 84 in. o/c

4. Design Wind Pressures: MWFRS Envelope Procedure

Load Case A: Transverse Direction			
Surface	GCpf	Design Pressure (psf)	
		(w/ +GCpi)	(w/ -GCpi)
1	0.54	7.21	14.47
2	-0.45	-12.79	-5.53
3	-0.47	-13.04	-5.78
4	-0.41	-11.98	-4.72
1E	0.77	11.92	19.18
2E	-0.72	-18.12	-10.87
3E	-0.65	-16.70	-9.44
4E	-0.60	-15.69	-8.43
2OH	-0.45	-9.16	
2EOH	-0.72	-14.49	
3OH	-0.47	-9.41	
3EOH	-0.65	-13.07	
2OH+W	-0.45/-0.7	-23.27	
2EOH+W	-0.72/-0.7	-28.61	

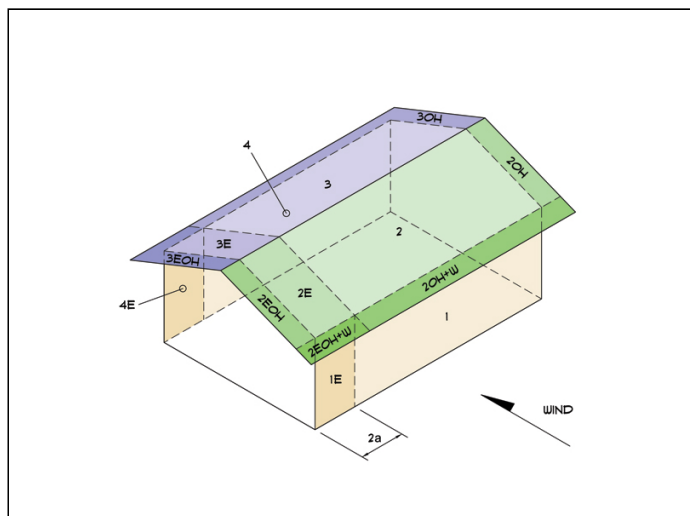

- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
 b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
 c) Design building for all wind directions, 4 load patterns per load case.
 d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
 e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
 f) Design pressures are for strength design, multiply by 0.6 for ASD.

Subject: Customer Location

Job No.

Engr. Wind Loads	Corn Bros. Properties, Inc.	NW Corner of Park	 <p>This report may not be reproduced or distributed without the written consent of Corn Bros. Properties, Inc.</p> <p>Copyright © 2025</p>	Rev. 2025C33
Date Clair Kaye, P.E.	Corn Bros. Properties, Inc.			Page -
1/9/2025	1096 Co Rd 1200 N Toledo, IL 62468 ph. 217-849-2560 email: clairkaye@gmail.com			1

Load Case B: Longitudinal Direction

Surface	GCpf	Design Pressure (psf)	
		(w/ +GCpi)	(w/ -GCpi)
1	-0.45	-12.70	-5.44
2	-0.69	-17.54	-10.28
3	-0.37	-11.09	-3.83
4	-0.45	-12.70	-5.44
5	0.40	4.44	11.69
6	-0.29	-9.48	-2.22
1E	-0.48	-13.31	-6.05
2E	-1.07	-25.20	-17.94
3E	-0.53	-14.31	-7.06
4E	-0.48	-13.31	-6.05
5E	0.61	8.67	15.93
6E	-0.43	-12.30	-5.04
2OH	-0.69	-13.91	
2EOH	-1.07	-21.57	
3OH	-0.37	-7.46	
3EOH	-0.53	-10.69	
2EOH+W	-1.07/-0.7	-35.69	
3EOH+W	-0.53/-0.7	-24.80	




- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
- c) Design building for all wind directions, 4 load patterns per load case.
- d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
- e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
- f) Design pressures are for strength design, multiply by 0.6 for ASD.

Torsional Load Cases

Surface	Load Case	GCpf	Design Pressure (psf)	
			(w/ +GCpi)	(w/ -GCpi)
1T	A	-	1.80	3.62
2T	A	-	-3.20	-1.38
3T	A	-	-3.26	-1.45
4T	A	-	-3.00	-1.18
5T	B	-	1.11	2.92
6T	B	-	-2.37	-0.55




- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) Pressures designated with a "T" are 25% of full design wind pressures.
- c) Torsional loading shall apply to all 8 load patterns using the figures shown.
- d) Design pressures are for strength design, multiply by 0.6 for ASD.
- e) Torsional Design Exceptions: One story bldg. with $h \leq 30$ ft.
Two stories or less framed with light frame construction,
Two stories or less with flexible diaphragms.

Subject Wind Loads	Customer Corn Bros. Properties, Inc.	Location NW Corner of Park and Crawford St Effingham	Job No. 2025C33
Engr. Clair Kaye, P.E.	Corn Bros. Properties, Inc. 1096 Co Rd 1200 N Toledo, IL 62468 ph. 217-849-2560 email: clairkaye@gmail.com		Rev. -
Date 1/9/2025			Page 2

5. Wind Load Calculations

1.) Lateral Loads - Transverse Direction:

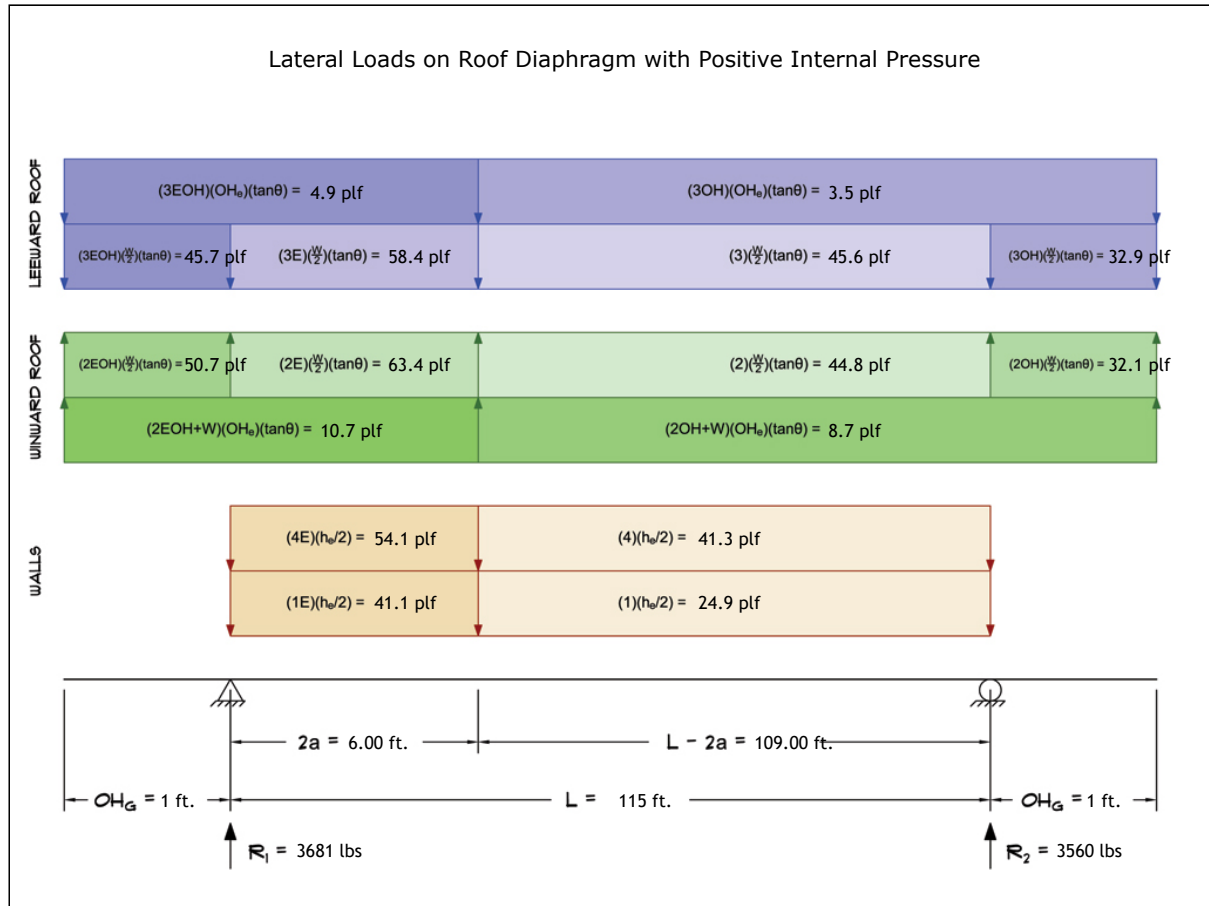


- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.
 b) Strength design values multiplied by 0.6 to obtain ASD values.

Wind Base Shear (ASD)						
Load Case A: Transverse Direction						
Load Case	Walls (lbs)	Roof (lbs)	Roof Overhangs (lbs)	Total Lateral Load (lbs)	R ₁ (lbs)	R ₂ (lbs)
Positive Internal Pressure	7790	68	-617	7241	3681	3560
Negative Internal Pressure	7790	68	-617	7241	3681	3560
Roof Pressure = 0	7790	0	0	7790	3978	3813
Min. Pressures (8 psf, 16 psf)	6348	3220	407	9975	4988	4988

- a) Bottom half of wall neglected in tributary area calculations.
 b) Strength design values multiplied by 0.6 to obtain ASD values.

Subject Wind Loads	Customer Corn Bros. Properties, Inc.	Location NW Corner of Park and Crawford St Effingham	Job No. 2025C33
Engr. Clair Kaye, P.E.	Corn Bros. Properties, Inc. 1096 Co Rd 1200 N Toledo, IL 62468 ph. 217-849-2560 email: clairkaye@gmail.com		Rev. -
Date 1/9/2025	 This report may not be copied, reproduced or distributed without the written consent of Corn Bros. Properties, Inc. Copyright © 2025		Page 3

2.) Lateral Loads - Longitudinal Direction:

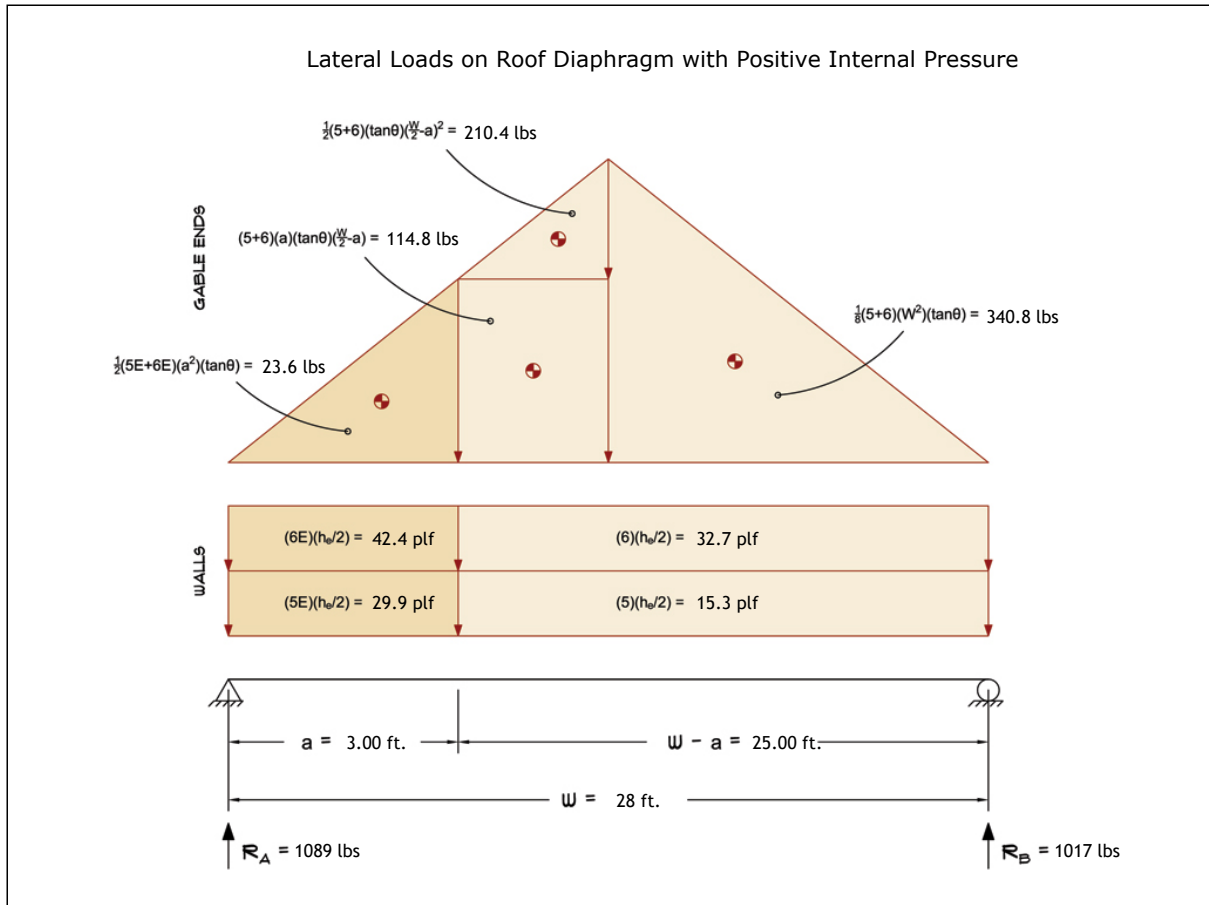


- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.
- b) Strength design values multiplied by 0.6 to obtain ASD values.
- c) Where the length of building (L) exceeds 4X the mean roof height (h), wind drag forces should additionally be considered.

Wind Base Shear (ASD)						
Load Case B: Longitudinal Direction						
Load Case	Walls (lbs)	Gable Ends (lbs)	Roof (lbs)	Total Lateral Load (lbs)	R _A (lbs)	R _B (lbs)
Positive Internal Pressure	1417	690	0	2106	1089	1017
Negative Internal Pressure	1417	690	0	2106	1089	1017
Roof Pressure = 0	1417	690	0	2106	1089	1017
Min. Pressures (8 psf, 16 psf)	1546	784	0	2330	1165	1165

- a) Bottom half of wall neglected in tributary area calculations.
- b) Strength design values multiplied by 0.6 to obtain ASD values.

Subject Wind Loads	Customer Corn Bros. Properties, Inc.	Location NW Corner of Park and Crawford St Effingham	Job No. 2025C33
Engr. Clair Kaye, P.E.	Corn Bros. Properties, Inc. 1096 Co Rd 1200 N Toledo, IL 62468 ph. 217-849-2560 email: clairkaye@gmail.com		Rev. -
Date 1/9/2025			 This report may not be copied, reproduced or distributed without the written consent of Corn Bros. Properties, Inc. Copyright © 2025

3.) Roof Truss Reactions:

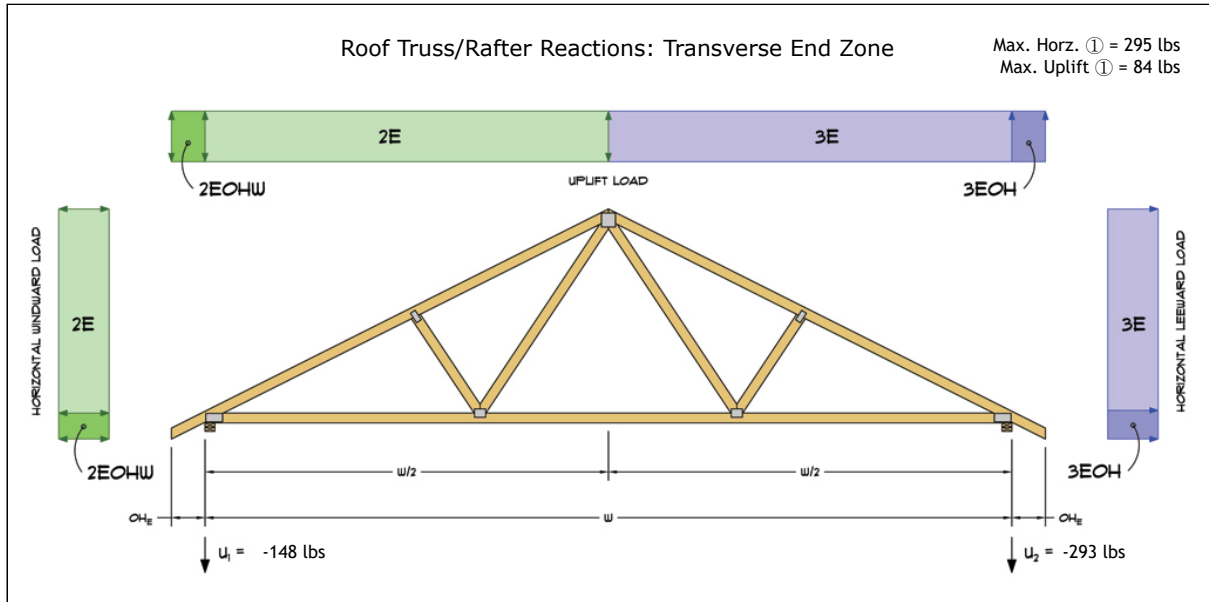

- a) Strength design values multiplied by 0.6 to obtain ASD values.
- b) Windward loads may be positive or negative depending on pitch of roof.

Roof Truss/Rafter Reactions (ASD)					
w/ Positive Internal Pressure					
Load Case	Horizontal Load (lbs)	Gross Uplift (lbs)	Net Uplift (lbs)	U ₁ (lbs)	U ₂ (lbs)
Transverse Int. Zone	30	1725	-1027	-471	-556
Transverse End Zone	76	2310	-441	-148	-293
Longitudinal Int. Zone	175	1818	-933	-350	-583
Longitudinal End Zone	295	2527	-225	84	-308

- a) Gross Uplift calculations do not include any counteracting roof dead loads.
- b) Net Uplift calculations include counteracting roof dead loads multiplied by 0.6 per load case (7) ASCE 7-10.
- c) Strength design values multiplied by 0.6 to obtain ASD values for wind loads.
- d) Loads based on truss spacing calculated at 84" o/c.
- e) Negative values for horizontal load indicate load acting in windward direction (transverse load cases).
- f) Negative values for uplift indicate net downward force (zero uplift).

*Disclaimer: The calculations produced herein are for initial design and estimating purposes only. The calculations and drawings presented do not constitute a fully engineered design. All of the potential load cases required to fully design an actual structure may not be provided by this calculator. For the design of an actual structure, a registered and licensed professional should be consulted as per IRC 2012 Sec. R802.10.2 and designed according to the minimum requirements of ASCE 7-10. The wind load calculations provided by this online tool are for educational and illustrative purposes only. Medeek Design assumes no liability or loss for any designs presented and does not guarantee fitness for use.

Subject Wind Loads	Customer Corn Bros. Properties, Inc.	Location NW Corner of Park and Crawford St Effingham	Job No. 2025C33
Engr. Clair Kaye, P.E.	Corn Bros. Properties, Inc. 1096 Co Rd 1200 N Toledo, IL 62468 ph. 217-849-2560 email: clairkaye@gmail.com		Rev. -
Date 1/9/2025	 This report may not be copied, reproduced or distributed without the written consent of Corn Bros. Properties, Inc. Copyright © 2025		Page 5