



MEDEEK DESIGN  
INC.  
400 SOUTH OF HANCOCK IN WOOD  
P.O. BOX 1130 - 04740 HAMMILL  
DURHAM, NH 03824  
TEL: 603-883-1130  
WWW.MEDEEKDESIGN.COM


PLAN NO. **SHOP4824-A6DB**  
SCALE: 1/8" = 1'-0"  
REVISION: A.1.1

DESIGNED BY: **NFW**  
DATE: **3/24/2012**

SHEET CONTENTS:  
**TRUSS DETAILS & CONNECTORS**


REVISION HISTORY:	

CUSTOMER:	
LOCATION:	
SHEET	

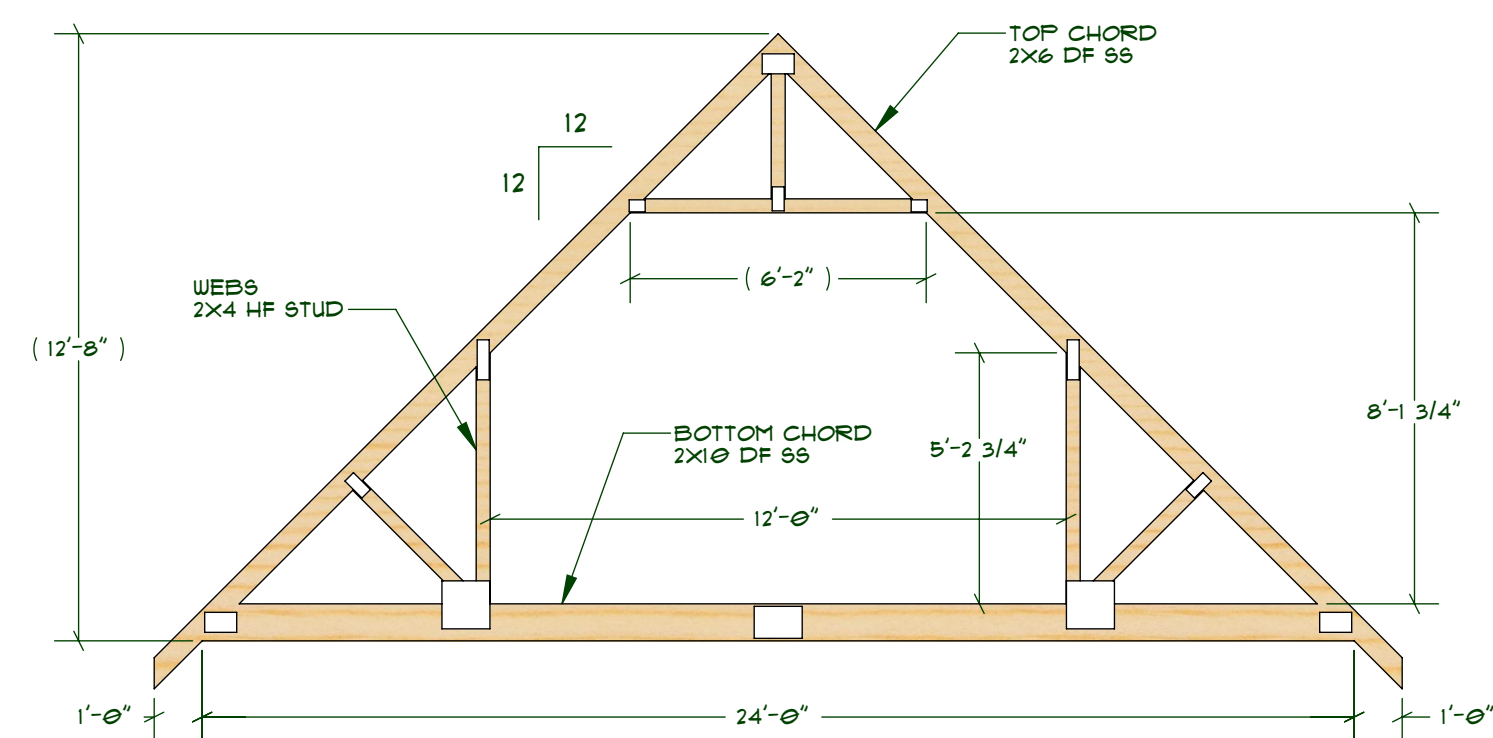


① 1 PLY ATTIC TRUSS DETAIL

SCALE: 1/4"=1'-0"  
QTY. 10

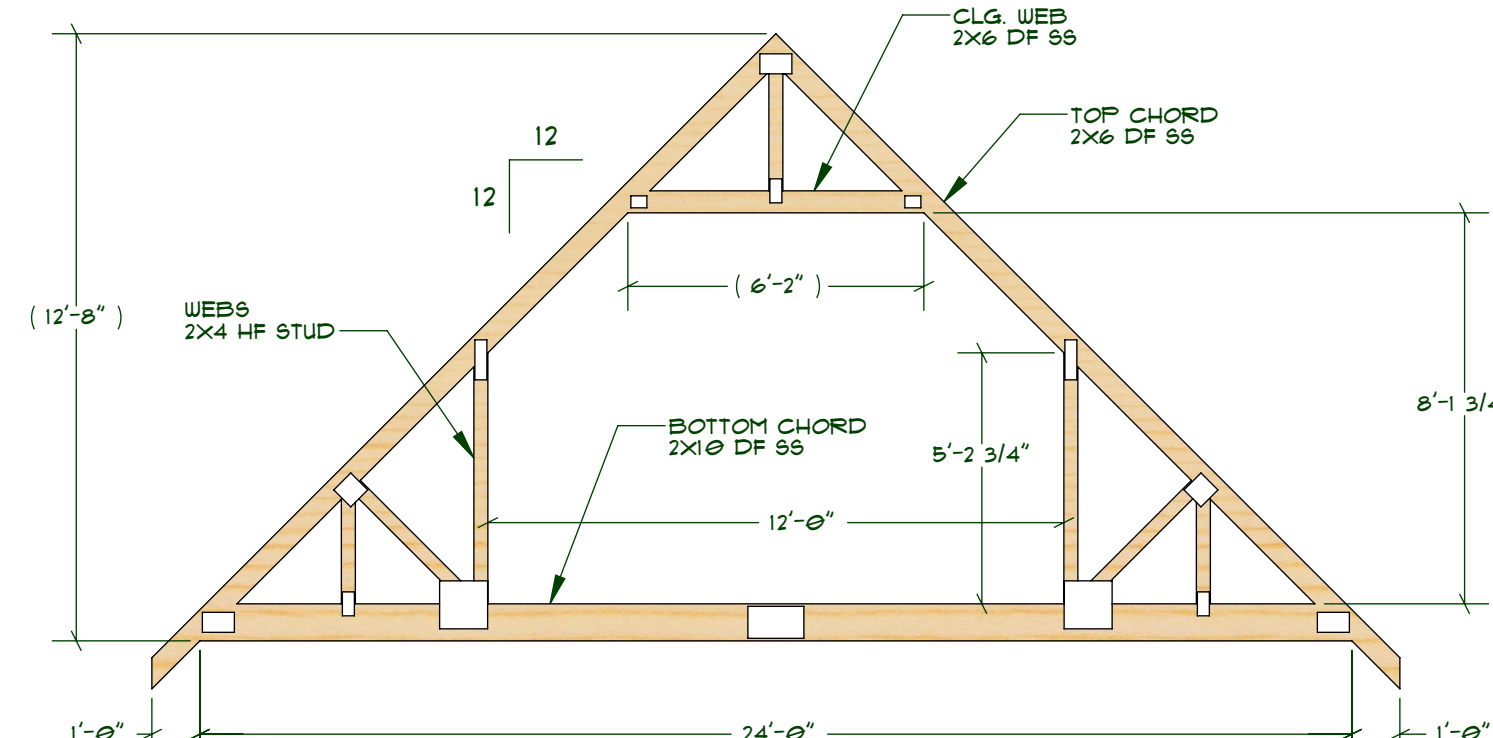


③ 3 PLY ATTIC TRUSS DETAIL

SCALE: 1/4"=1'-0"  
QTY. 6

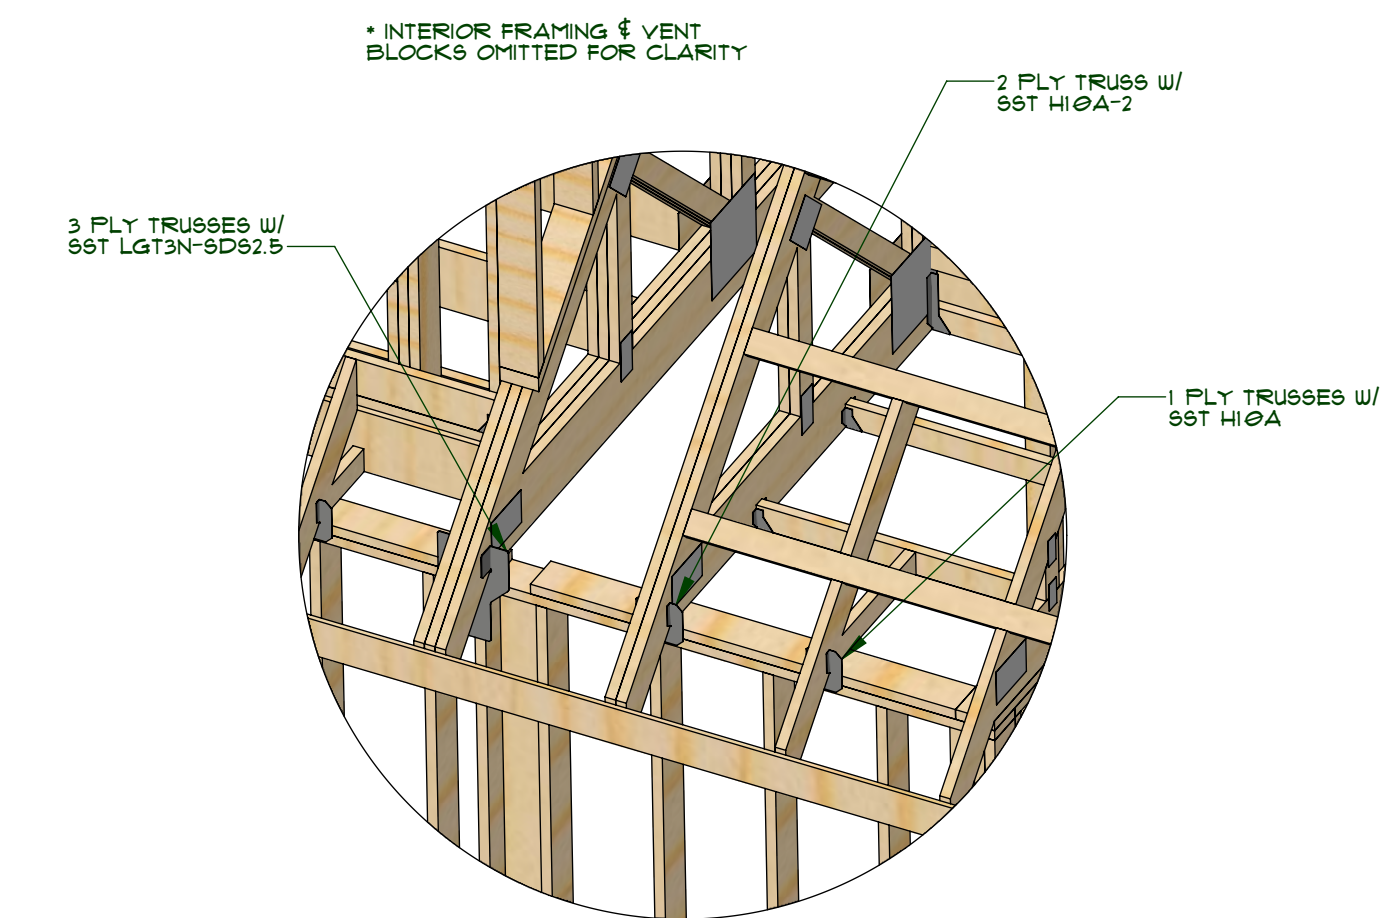


⑤ TRUSS CONNECTORS DETAIL

SCALE: 1/2"=1'-0"

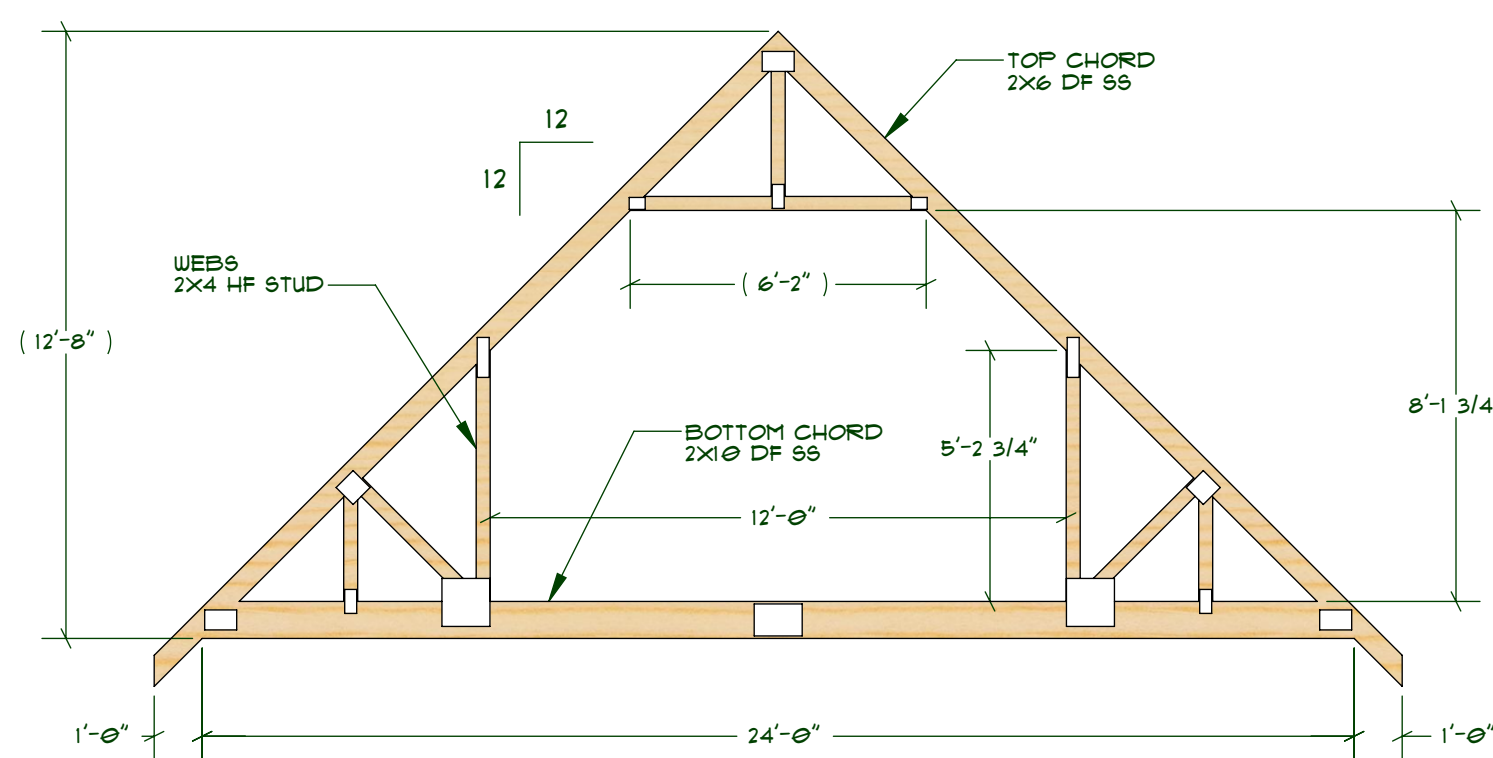


② 2 PLY ATTIC TRUSS DETAIL

SCALE: 1/4"=1'-0"  
QTY. 1

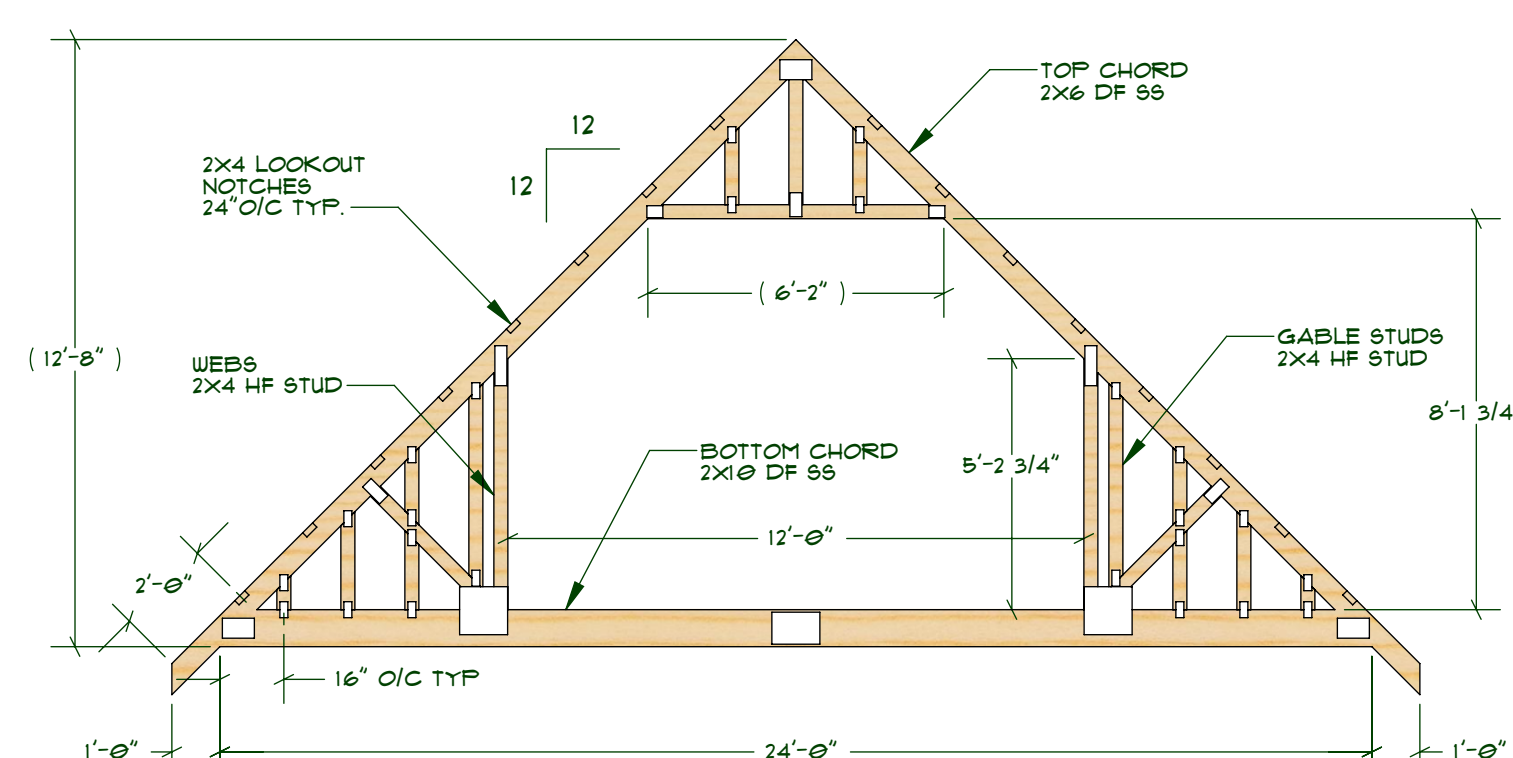

④ GABLE ATTIC TRUSS DETAIL

SCALE: 1/4"=1'-0"  
QTY. 2

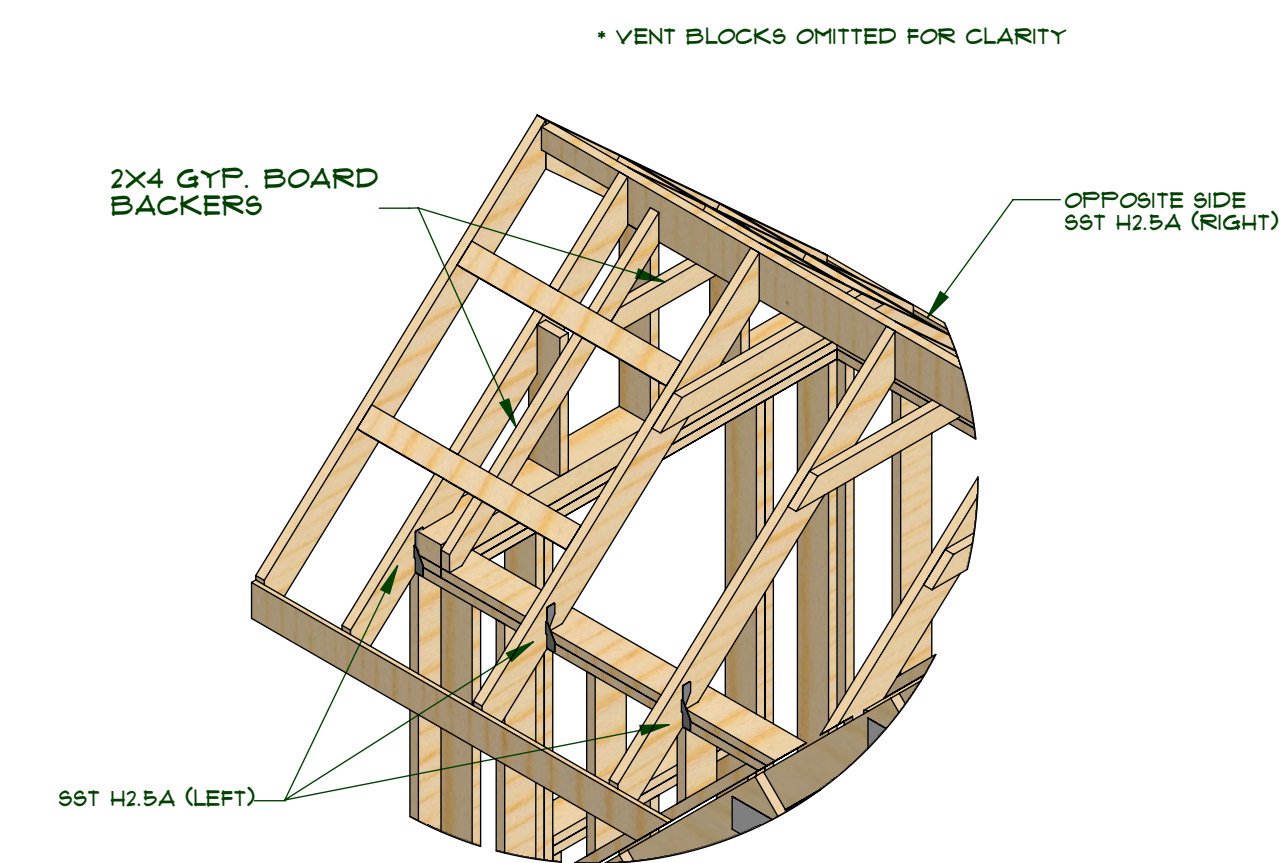

⑥ DORMER CONNECTORS DETAIL

SCALE: 1/2"=1'-0"

**TRUSS GENERAL NOTES:**

- INSTALL TRUSSES AS PER MANUF. SPECS.
- TRUSS CONSTRUCTION DOCUMENTS SHALL BE PREPARED BY A REGISTERED DESIGN PROFESSIONAL AND SHALL BE APPROVED BY LOCAL BUILDING OFFICIAL PRIOR TO INSTALLATION.
- TRUSS DOCUMENTATION AS PROVIDED BY ABOVE BECOMES PART OF FLANSSET.
- TRUSS DOCUMENTS TO COMPLY WITH ALL LOCAL CODES AND 2009 IRC REQUIREMENTS.
- MINIMUM DESIGN PARAMETERS:
  - WIND SPEED: 100 MPH
  - WIND EXPOSURE: "C"
  - SEISMIC CATEGORY: A, B, C, D
  - SNOW LOAD: 30 LBS/SQFT

**TRUSS REQUIREMENTS**

- R002101 TRUSS DESIGN DRAWINGS:** TRUSS DESIGN DRAWINGS, PREPARED IN CONFORMANCE TO SECTION R002101, SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO INSTALLATION. TRUSS DESIGN DRAWINGS SHALL INCLUDE, AT A MINIMUM, THE INFORMATION SPECIFIED BELOW. TRUSS DESIGN DRAWING SHALL BE PROVIDED WITH THE SHIPMENT OF TRUSSES DELIVERED TO THE JOBSITE.
1. SLOPE OR DEPTH, SPAN AND SPACING.
  2. LOCATION OF ALL JOINTS.
  3. REQUIRED BEARING WIDTHS.
  4. DESIGN LOADS AS APPLICABLE.
    - 4.1. TOP CHORD LIVE LOAD (AS DETERMINED FROM SECTION R301.6, IRC 2009).
    - 4.2. TOP CHORD DEAD LOAD.
    - 4.3. BOTTOM CHORD LIVE LOAD.
    - 4.4. BOTTOM CHORD DEAD LOAD.
    - 4.5. CONCENTRATED LOADS AND THEIR POINTS OF APPLICATION.
    - 4.6. CONTROLLING WIND AND EARTHQUAKE LOADS.
  5. ADJUSTMENTS TO LUMBER AND JOINT CONNECTOR DESIGN VALUES FOR CONDITIONS OF USE.
  6. EACH REACTION FORCE AND DIRECTION.
    - 6.1. JOINT CONNECTOR TYPE AND DESCRIPTION (E.G., SIZE, THICKNESS OR GAGE) AND THE DIMENSIONED LOCATION OF EACH JOINT CONNECTOR EXCEPT WHERE SYMMETRICALLY LOCATED RELATIVE TO THE JOINT INTERFACE.
    - 6.2. TRUSS FLY TO FLY.
    - 6.3. FIELD SPICES.
  7. LUMBER SIZE, SPECIES AND GRADE FOR EACH MEMBER.
  8. CONNECTION REQUIREMENTS FOR:
    - 8.1. TRUSS TO GIRDER/TRUSS.
    - 8.2. TRUSS FLY TO FLY.
    - 8.3. FIELD SPICES.
  9. CALCULATED DEFLECTION RATIO AND/OR MAXIMUM DEFLECTION FOR LIVE AND TOTAL LOAD.
  10. MAXIMUM AXIAL COMPRESSION FORCES IN THE TRUSS MEMBERS TO ENABLE THE BUILDING DESIGNER TO DESIGN THE SIZE, CONNECTIONS AND ANCHORAGE OF THE PERMANENT CONTINUOUS LATERAL BRACING FORCES SHALL BE SHOWN ON THE TRUSS DESIGN DRAWING OR ON SUPPLEMENTAL DOCUMENTS.
  11. REQUIRED PERMANENT TRUSS MEMBER BRACING LOCATION.