


Beam Design

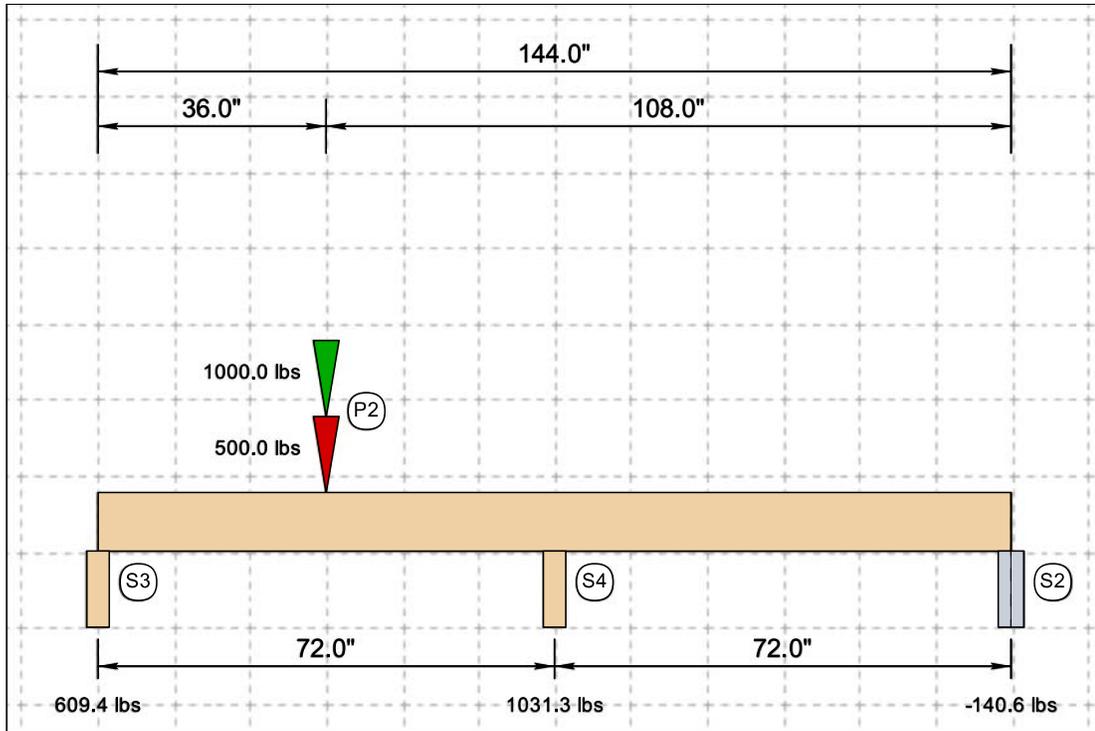

Design Results	Location	Actual	Allowed	Result	C _D	Load Combination
Reaction (lbs)	S4	1031.3	3281.3	31%	-	D + L
Shear (lbs)	37"	890.6	1665.0	53%	1.0	D + L
Neg. Moment (ft-lbs)	72"	844	1692	50%	1.0	D + L
Pos. Moment (ft-lbs)	36"	1828	1692	108%	1.0	D + L
LL Deflection (in)	35"	0.0333	0.2	L/2162	-	D + L
TL Deflection (in)	35"	0.05	0.3	L/1441	-	D + L

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			 This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC. Copyright © 2025

1. Beam Data

Beam Type: Sawn Lumber
 Species: Douglas Fir-Larch
 Grade: DF No. 1
 Size: 1.5 x 9.25 in.
 Beam Length: 12.0 ft.
 Beam Ply (N): 1
 Beam Weight: 39.5 lbs
 Code Standard: ASCE7-22, NDS 2024
 Notes:

2. Design Options

Lateral Support (B): unbraced
 Lateral Support (T): unbraced
 Defl. Limits: 360|240
 Load Duration (V): 1.0
 Load Duration (M): 1.0/1.0
 Exposure: dry
 Temperature: $T \leq 100^{\circ}\text{F}$
 Orientation: Vertical
 Incised: No
 Rep. Members: No

3. Adjustment Factors

Factor	Description	F_b	F_t	F_v	F_c	$F_{c\perp}$	E/E_{min}
C_D	Load Duration Factor	1.0/1.0	-	1.0	-	-	-
C_M	Wet Service Factor	1.0 ^b	1.0	1.0	1.0 ^c	1.0	1.0
C_t	Temperature Factor	1.0	1.0	1.0	1.0	1.0	1.0
C_L	Beam Stability Factor	0.86/0.86	-	-	-	-	-
C_F	Size Factor	1.1	1.1	-	1.0	-	-
C_{fu}	Flat Use Factor	1.2 ^d	-	-	-	-	-
C_i	Incising Factor	1.0	1.0	1.0	1.0	1.0	1.0
C_r	Rep. Member Factor	1.0	-	-	-	-	-

a) Adjustment factors per AWC NDS 2024 and NDS 2024 Supplement.

b) When $(F_b)(C_F) \leq 1,150$ psi, $C_M = 1.0$.

c) When $(F_c)(C_F) \leq 750$ psi, $C_M = 1.0$.

d) Only applies when sawn lumber or glulam beams are loaded in bending about the y-y axis.

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			
			Copyright © 2025

6. Beam Calculations

Determine reference design values, sectional properties and self weight of beam:

$$A = b \times d = 1.5 \times 9.25 = 13.875 \text{ in.}^2$$

$$S_x = \frac{bd^2}{6} = (1.5)(9.25)^2/6 = 21.391 \text{ in.}^3, \quad S_y = \frac{b^2d}{6} = (1.5)^2(9.25)/6 = 3.469 \text{ in.}^3$$

$$I_x = \frac{bd^3}{12} = (1.5)(9.25)^3/12 = 98.932 \text{ in.}^4, \quad I_y = \frac{b^3d}{12} = (1.5)^3(9.25)/12 = 2.602 \text{ in.}^4$$

Reference Design Values from Table 4A NDS Supplement (Reference Design Values for Visually Graded Dimension Lumber, 2" - 4" thick).

Species & Grade	F _b	F _t	F _v	F _{c⊥}	F _c	E	E _{min}	SG
DF No.1	1000	675	180	625	1500	1700000	620000	0.5

The following formula shall be used to determine the density of wood (lbs/ft³). (NDS Supplement Sec. 3.1.3)

$$\rho_w = 62.4 \left[\frac{SG}{1+SG(0.009)(m.c)} \right] \left[1 + \frac{m.c.}{100} \right] = 62.4 \left[\frac{0.5}{1+0.5(0.009)(19)} \right] \left[1 + \frac{19}{100} \right] = 34.2 \text{ lbs/ft}^3$$

where:

ρ_w = Density of wood (lbs/ft³)

SG = 0.5 Specific gravity of wood (dimensionless)


m.c. = 19 % (Max. moisture content at dry service conditions)

$$\text{Volume}_{\text{beam}} = N[A \times L] = 1 \times [13.875 \times 144.0] \div (12 \text{ in./ft.})^3 = 1.16 \text{ ft}^3$$


$$\text{Self Weight (W}_s) = \rho_w \times \text{Volume}_{\text{beam}} = 34.2 \times 1.16 = 39.55 \text{ lbs}$$

$$\text{Distributed Self Weight (w}_s) = \frac{W_s}{L} = \frac{39.55}{12.0} = 3.296 \text{ plf}$$

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			
			<small>This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC.</small> <small>Copyright © 2025</small>

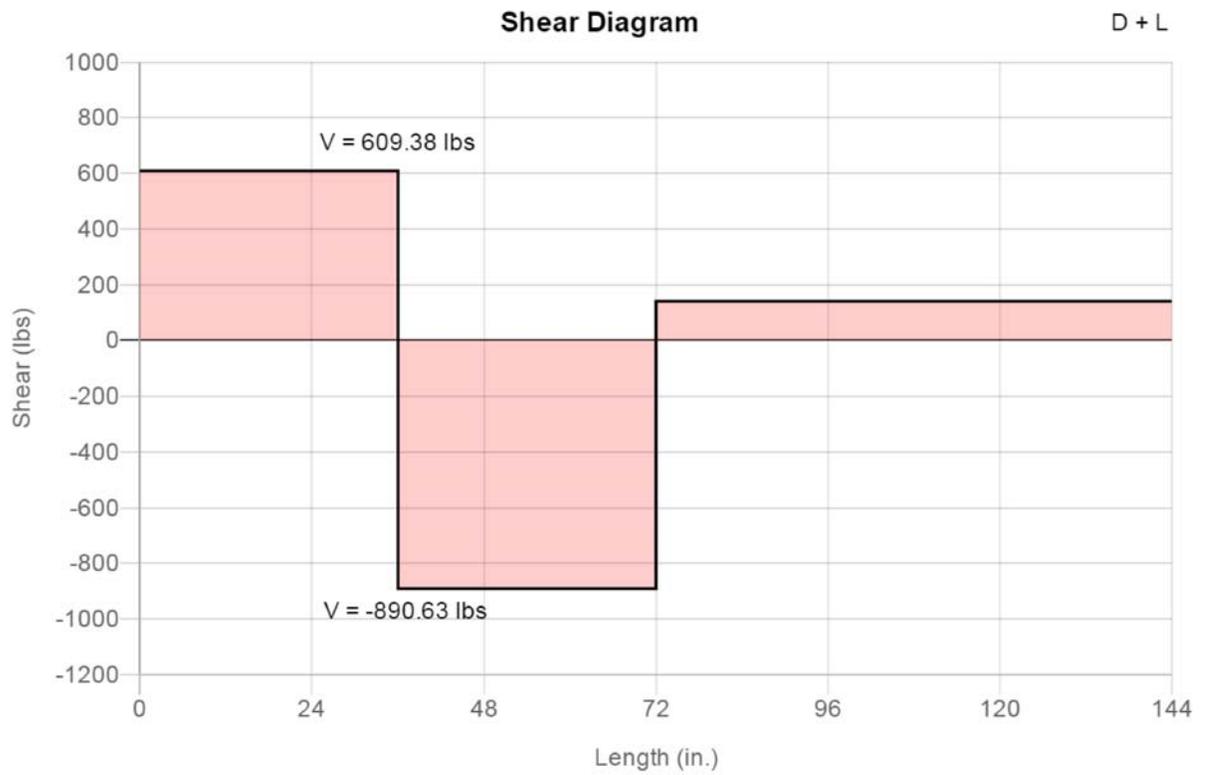


Shear Load Case: **D + L** ▼

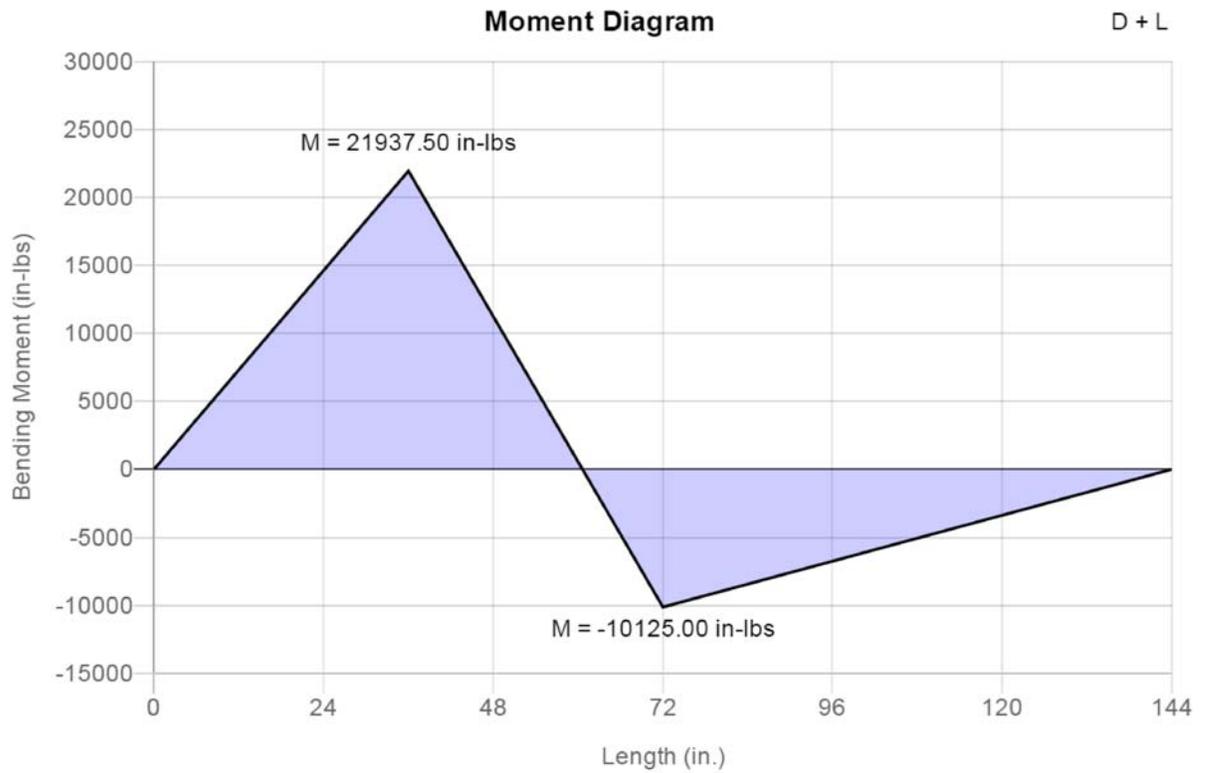


Moment Load Case: **D + L** ▼

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			
			Copyright © 2025

This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC.

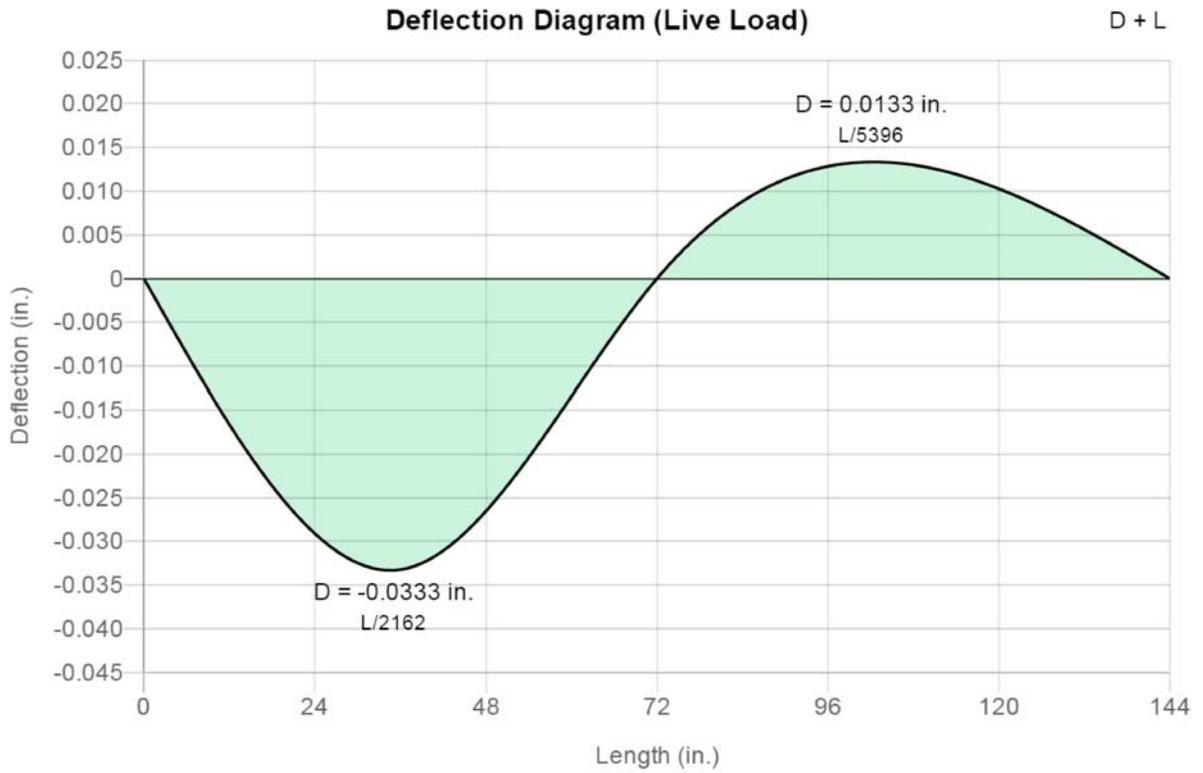

Deflection Load Case: **D + L** ▼

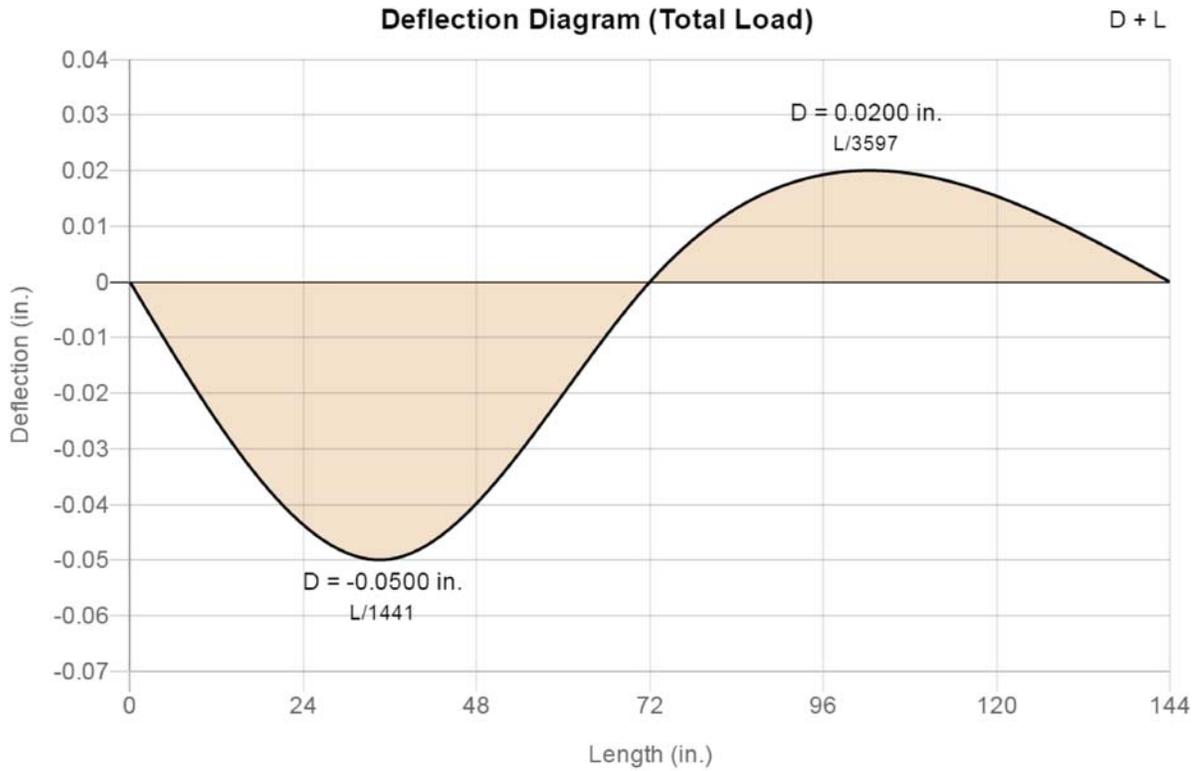

Deflection Load Case: **D + L** ▼

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			Page 5
This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC.			Copyright © 2025

2.) Shear:

Members subject to shear stresses shall be proportioned so that the actual shear stress parallel to grain or shear force at any cross section of the bending member shall not exceed the adjusted shear design value:

$$f_v \leq F_v' \text{ (NDS Sec. 3.4.1)}$$

where:

$$f_v = \frac{3V}{2A}$$

$$F_v' = F_v(C_D)(C_M)(C_t)$$

$$F_{vx}' = (180)(1.0)(1.0)(1.0) = 180.00 \text{ psi}$$

$$f_v = \frac{3V}{2(N \times A)} = \frac{3(890.62)}{2(1 \times 13.875)} = 96.28 \text{ psi}$$

$$f_v = 96.28 \text{ psi} < F_{vx}' = 180.00 \text{ psi} \text{ (CSI} = 0.53) \rightarrow \text{OK}$$

3.) Deflection:

Bending deflections calculated per standard method of engineering mechanics for live load and total load:

LL Allowable: $L/360$

TL Allowable: $L/240$

$$E_x' = E_x(C_M)(C_t)(C_i) = 1700000(1.0)(1.0)(1.0) = 1700000 \text{ psi}$$

$$\Delta_{LL} = -0.0333 \text{ in.}$$

$$(L/d)_{LL} = 72.0 / -0.0333 = 2162$$

$$\Delta_{LL} = -0.0333 \text{ in} = L/2162 < L/360 \rightarrow \text{OK}$$

Calculations shown for load combination "D + L" at location $x = 35$ in.

$$\Delta_{TL} = -0.05 \text{ in.}$$

$$(L/d)_{TL} = 72.0 / -0.05 = 1441$$

$$\Delta_{TL} = -0.05 \text{ in} = L/1441 < L/240 \rightarrow \text{OK}$$

Calculations shown for load combination "D + L" at location $x = 35$ in.

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			Page 6

This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC.

Copyright © 2025

1.) Bending:

Members subject to bending stresses shall be proportioned so that the actual bending stress or moment shall not exceed the adjusted bending design value:

$$f_b \leq F_b' \text{ (NDS Sec. 3.3.1)}$$

where:

$$f_b = M / S$$

$$F_b' = F_b(C_D)(C_M)(C_t)(C_L)(C_F)(C_{fu})(C_i)(C_r)$$

Negative Bending: Beam is unbraced along its compression (bottom) edge, lateral stability is considered below:

Slenderness Ratio for bending member R_B :

$$l_u = \text{Unbraced Length} = 72.0 \text{ in.}$$

$$l_u/d = \frac{72.0}{9.25} = 7.78$$

$$l_e = 1.63l_u + 3d = 1.63(72.0) + 3(9.25) = 145.11 \text{ in. (NDS Table 3.3.3)}$$

$$R_b = \sqrt{\frac{l_e d}{b^2}} = \sqrt{\frac{145.11(9.25)}{(1 \times 1.5)^2}} = 24.42$$

$$R_b = 24.42 < 50 \rightarrow \text{OK}$$

Euler-based ASD critical buckling value for bending members:

$$E_{\text{miny}}' = E_{\text{miny}}(C_M)(C_t)(C_i) = 620000(1.0)(1.0)(1.0) = 620000 \text{ psi}$$

$$F_{bE} = \frac{1.2E'_{\text{miny}}}{(R_b)^2} = \frac{1.2(620000)}{(24.42)^2} = 1247.14 \text{ psi}$$

$$F_{bx}^* = F_{bx}(C_D)(C_M)(C_t)(C_F)(C_i)(C_r) = (1000)(1.0)(1.0)(1.0)(1.1)(1.0)(1.0) = 1100.0 \text{ psi}$$

Beam stability factor:

$$C_L = \frac{1 + F_{be}/F_{bx}^*}{1.9} - \sqrt{\left(\frac{1 + F_{be}/F_{bx}^*}{1.9}\right)^2 - \frac{F_{be}/F_{bx}^*}{0.95}} = \frac{1 + 1247.14/1100.0}{1.9} - \sqrt{\left(\frac{1 + 1247.14/1100.0}{1.9}\right)^2 - \frac{1247.14/1100.0}{0.95}} = 0.863$$

$$F_{bx}' = (1000)(1.0)(1.0)(1.0)(0.863)(1.1)(1.0)(1.0) = 949.0 \text{ psi}$$

$$f_b = \frac{M}{N \times S_x} = \frac{10125}{1 \times 21.39} = 473.3 \text{ psi}$$

$$f_b = 473.3 \text{ psi} < F_{bx}' = 949.0 \text{ psi (CSI = 0.5)} \rightarrow \text{OK}$$

Calculations shown for load combination "D + L" at location x = 72 in.

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			 This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC. Page 7 Copyright © 2025

Positive Bending: Beam is unbraced along its compression (top) edge, lateral stability is considered below:

Slenderness Ratio for bending member R_B :

l_u = Unbraced Length = 72.0 in.

$$l_u/d = \frac{72.0}{9.25} = 7.78$$

$$l_e = 1.63l_u + 3d = 1.63(72.0) + 3(9.25) = 145.11 \text{ in. (NDS Table 3.3.3)}$$

$$R_b = \sqrt{\frac{l_e d}{b^2}} = \sqrt{\frac{145.11(9.25)}{(1 \times 1.5)^2}} = 24.42$$

$$R_b = 24.42 < 50 \rightarrow \mathbf{OK}$$

Euler-based ASD critical buckling value for bending members:

$$E_{\text{miny}}' = E_{\text{miny}}(C_M)(C_T)(C_i) = 620000(1.0)(1.0)(1.0) = 620000 \text{ psi}$$

$$F_{bE} = \frac{1.2E'_{\text{miny}}}{(R_b)^2} = \frac{1.2(620000)}{(24.42)^2} = 1247.14 \text{ psi}$$

$$F_{bx}^* = F_{bx}(C_D)(C_M)(C_t)(C_F)(C_j)(C_r) = (1000)(1.0)(1.0)(1.0)(1.1)(1.0)(1.0) = 1100.0 \text{ psi}$$

Beam stability factor:

$$C_L = \frac{1 + F_{be}/F_{bx}^*}{1.9} - \sqrt{\left(\frac{1 + F_{be}/F_{bx}^*}{1.9}\right)^2 - \frac{F_{be}/F_{bx}^*}{0.95}} = \frac{1 + 1247.14/1100.0}{1.9} - \sqrt{\left(\frac{1 + 1247.14/1100.0}{1.9}\right)^2 - \frac{1247.14/1100.0}{0.95}} = 0.863$$

$$F_{bx}' = (1000)(1.0)(1.0)(1.0)(0.863)(1.1)(1.0)(1.0) = 949.0 \text{ psi}$$

$$f_b = \frac{M}{N \times S_x} = \frac{21938}{1 \times 21.39} = 1025.6 \text{ psi}$$

$$f_b = 1025.6 \text{ psi} > F_{bx}' = 949.0 \text{ psi (CSI = 1.08)} \rightarrow \mathbf{NG}$$

Calculations shown for load combination "D + L" at location x = 36 in.

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			 This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC. Copyright © 2025

4.) Bearing:

Members subject to bearing stresses perpendicular to the grain shall be proportioned so that the actual compressive stress perpendicular to grain shall be based on the net bearing area and shall not exceed the adjusted compression design value perpendicular to grain:

$$f_{c\perp} \leq F_{c\perp}' \quad (\text{NDS Sec. 3.10.2})$$

where:

$$F_{c\perp}' = F_{c\perp}(C_M)(C_t)(C_i)$$

$$F_{c\perp X}' = (625)(1.0)(1.0)(1.0) = 625.00 \text{ psi}$$

$$f_{c\perp} = \frac{R}{A_b}$$

$$A_b = b \times l_b = 1.5 \times 3.5 = 5.25 \text{ in}^2$$

$$f_{c\perp} = \frac{R}{N \times A_b} = \frac{1031.25}{1 \times 5.25} = 196.4 \text{ psi}$$

$$f_{c\perp} = 196.4 \text{ psi} < F_{c\perp X}' = 625.00 \text{ psi} \quad (\text{CSI} = 0.31) \quad \rightarrow \text{OK}$$

Calculations shown for load combination "D + L" at support S4.

*Disclaimer: The output and calculations produced herein are based on building code-accepted design values and standard engineering and analysis methods. Medeek Engineering expressly disclaims all other warranties related to this software. A licensed design professional or qualified engineer should be consulted to verify that the appropriate inputs have been utilized, prior to anyone relying on such output as evidence of suitability for a particular application. Use of this software is not intended to circumvent the need for a design professional as determined by the jurisdiction. All loads, dimensions, supports and design options have been provided by Nathaniel Wilkerson.

Subject Beam Design	Customer John Smith	Location 123 S 234 W Provo, UT 84604	Job. No. 2025-002
Engr. Nathaniel Wilkerson	MEDEEK ENGINEERING LLC 1927 S 1030 W Orem, Utah 84058 ph. 425-652-4188 design.medeek.com		Rev. -
Date 08/05/2025			 This report may not be copied, reproduced or distributed without the written consent of Medeek Engineering LLC. Copyright © 2025