



# Wind Load Report - Wolf Creek Ski Area

## 1. Site & Building Data

|                                      |          |
|--------------------------------------|----------|
| Roof Type:                           | Gable    |
| Wind Speed (ult):                    | 115 mph  |
| Exposure Category:                   | C        |
| Enclosure Class:                     | Enclosed |
| Building Width (W):                  | 50 ft.   |
| Building Length (L):                 | 100 ft.  |
| Eave Height (h <sub>e</sub> ):       | 25.2 ft. |
| Foundation Height (h <sub>f</sub> ): | 0 ft.    |
| Roof Pitch:                          | 5 /12    |
| Eave Overhang (OH <sub>e</sub> ):    | 0 ft.    |
| Gable Overhang (OH <sub>g</sub> ):   | 0 ft.    |

## 2. Parameters & Coefficients

|                                                  |            |
|--------------------------------------------------|------------|
| Topographic Factor (K <sub>zt</sub> ):           | 1.3        |
| Directionality Factor (K <sub>d</sub> ):         | .85        |
| Roof Angle (θ):                                  | 22.62 deg. |
| Mean Roof Height (h):                            | 30.41 ft.  |
| Ridge Height (h <sub>r</sub> ):                  | 35.62 ft.  |
| Pos. Internal Pressure (+GC <sub>pi</sub> ):     | +0.18      |
| Neg. Internal Pressure (-GC <sub>pi</sub> ):     | -0.18      |
| Velocity Pressure Exp. Coeff. (K <sub>h</sub> ): | 0.99 @ z=h |
| Velocity Pressure (q <sub>h</sub> ):             | 36.85 psf  |
| End Zone Width (a):                              | 3.00 ft.   |
| Zone 2/2E Dist.:                                 | 25.00 ft.  |

## 3. Design Assumptions and Notes


|                |                      |
|----------------|----------------------|
| Code Standard: | ASCE 7-10            |
| Geometry:      | Regular-Shaped Bldg. |
| Height Class:  | Low-Rise Building    |
| Notes:         |                      |

## 4. Design Loads

|                         |            |
|-------------------------|------------|
| Top Chord Dead Load:    | 5 psf      |
| Bottom Chord Dead Load: | 5 psf      |
| Truss/Rafter Spacing:   | 12 in. o/c |

## 4. Design Wind Pressures: MWFRS Envelope Procedure

| Load Case A: Transverse Direction |                  |                         |                         |
|-----------------------------------|------------------|-------------------------|-------------------------|
| Surface                           | GC <sub>pf</sub> | Design Pressure (psf)   |                         |
|                                   |                  | (w/ +GC <sub>pi</sub> ) | (w/ -GC <sub>pi</sub> ) |
| 1                                 | 0.54             | 13.19                   | 26.45                   |
| 2                                 | -0.45            | -23.37                  | -10.11                  |
| 3                                 | -0.47            | -23.84                  | -10.57                  |
| 4                                 | -0.41            | -21.90                  | -8.63                   |
| 1E                                | 0.77             | 21.79                   | 35.05                   |
| 2E                                | -0.72            | -33.13                  | -19.86                  |
| 3E                                | -0.65            | -30.52                  | -17.25                  |
| 4E                                | -0.60            | -28.67                  | -15.41                  |

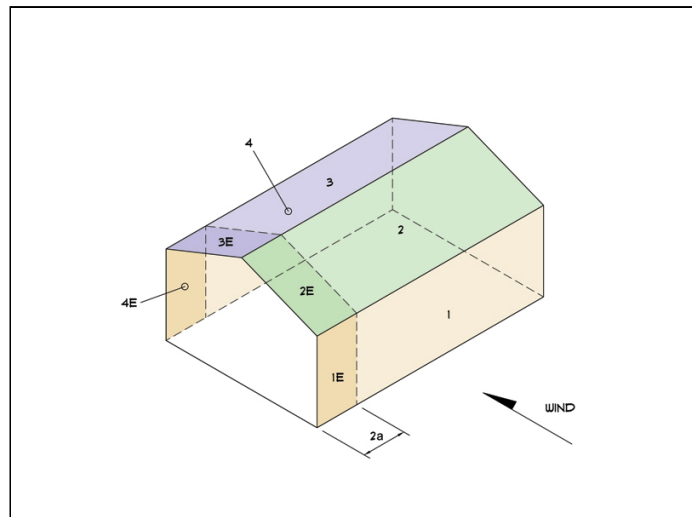

- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
- c) Design building for all wind directions, 4 load patterns per load case.
- d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
- e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
- f) Design pressures are for strength design, multiply by 0.6 for ASD.


|                               |                                                                     |                                |                             |
|-------------------------------|---------------------------------------------------------------------|--------------------------------|-----------------------------|
| Subject<br><b>Wind Loads</b>  | Customer<br><b>Summit Engineering Co</b>                            | Location<br><b>Alamosa, CO</b> | Job No.<br><b>260317MBP</b> |
| Engr.<br><b>Engineer Name</b> | <b>ENGINEERING COMPANY INC.</b>                                     |                                | Rev.<br>-                   |
| Date<br><b>4/12/2026</b>      | Street Address City, CA 99999<br>ph. (800) 000-0000 www.website.com |                                | Page<br><b>1</b>            |



This report may not be copied, reproduced or distributed without the written consent of Engineering Company Inc.

### Load Case B: Longitudinal Direction


| Surface | GCpf  | Design Pressure (psf) |            |
|---------|-------|-----------------------|------------|
|         |       | (w/ +GCpi)            | (w/ -GCpi) |
| 1       | -0.45 | -23.22                | -9.95      |
| 2       | -0.69 | -32.06                | -18.79     |
| 3       | -0.37 | -20.27                | -7.00      |
| 4       | -0.45 | -23.22                | -9.95      |
| 5       | 0.40  | 8.11                  | 21.37      |
| 6       | -0.29 | -17.32                | -4.05      |
| 1E      | -0.48 | -24.32                | -11.06     |
| 2E      | -1.07 | -46.06                | -32.80     |
| 3E      | -0.53 | -26.16                | -12.90     |
| 4E      | -0.48 | -24.32                | -11.06     |
| 5E      | 0.61  | 15.85                 | 29.11      |
| 6E      | -0.43 | -22.48                | -9.21      |

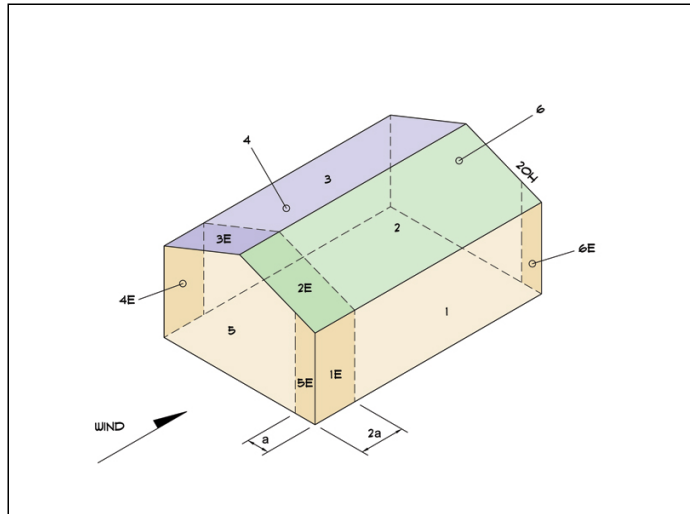

- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
- c) Design building for all wind directions, 4 load patterns per load case.
- d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
- e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
- f) Design pressures are for strength design, multiply by 0.6 for ASD.

### Torsional Load Cases

| Surface | Load Case | GCpf | Design Pressure (psf) |            |
|---------|-----------|------|-----------------------|------------|
|         |           |      | (w/ +GCpi)            | (w/ -GCpi) |
| 1T      | A         | -    | 3.30                  | 6.61       |
| 2T      | A         | -    | -5.84                 | -2.53      |
| 3T      | A         | -    | -5.96                 | -2.64      |
| 4T      | A         | -    | -5.48                 | -2.16      |
| 5T      | B         | -    | 2.03                  | 5.34       |
| 6T      | B         | -    | -4.33                 | -1.01      |

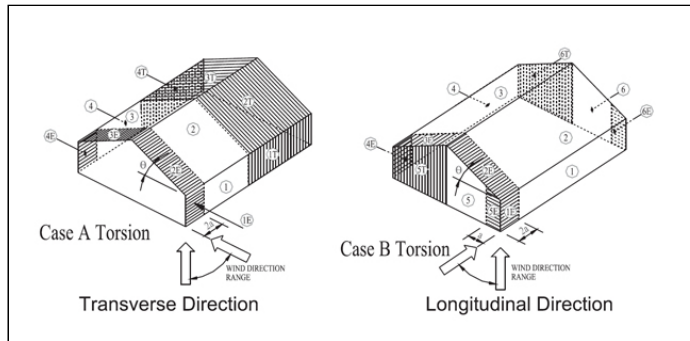

- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) Pressures designated with a "T" are 25% of full design wind pressures.
- c) Torsional loading shall apply to all 8 load patterns using the figures shown.
- d) Design pressures are for strength design, multiply by 0.6 for ASD.
- e) Torsional Design Exceptions: One story bldg. with  $h \leq 30$  ft,  
Two stories or less framed with light frame construction,  
Two stories or less with flexible diaphragms.


|                               |                                                                     |                                |                             |
|-------------------------------|---------------------------------------------------------------------|--------------------------------|-----------------------------|
| Subject<br><b>Wind Loads</b>  | Customer<br><b>Summit Engineering Co</b>                            | Location<br><b>Alamosa, CO</b> | Job No.<br><b>260317MBP</b> |
| Engr.<br><b>Engineer Name</b> | <b>ENGINEERING COMPANY INC.</b>                                     |                                | Rev.<br>-                   |
| Date<br><b>4/12/2026</b>      | Street Address City, CA 99999<br>ph. (800) 000-0000 www.website.com |                                | Page<br><b>2</b>            |



This report may not be copied, reproduced or distributed without the written consent of Engineering Company Inc.

## 5. Wind Load Calculations

### 1.) Lateral Loads - Transverse Direction:

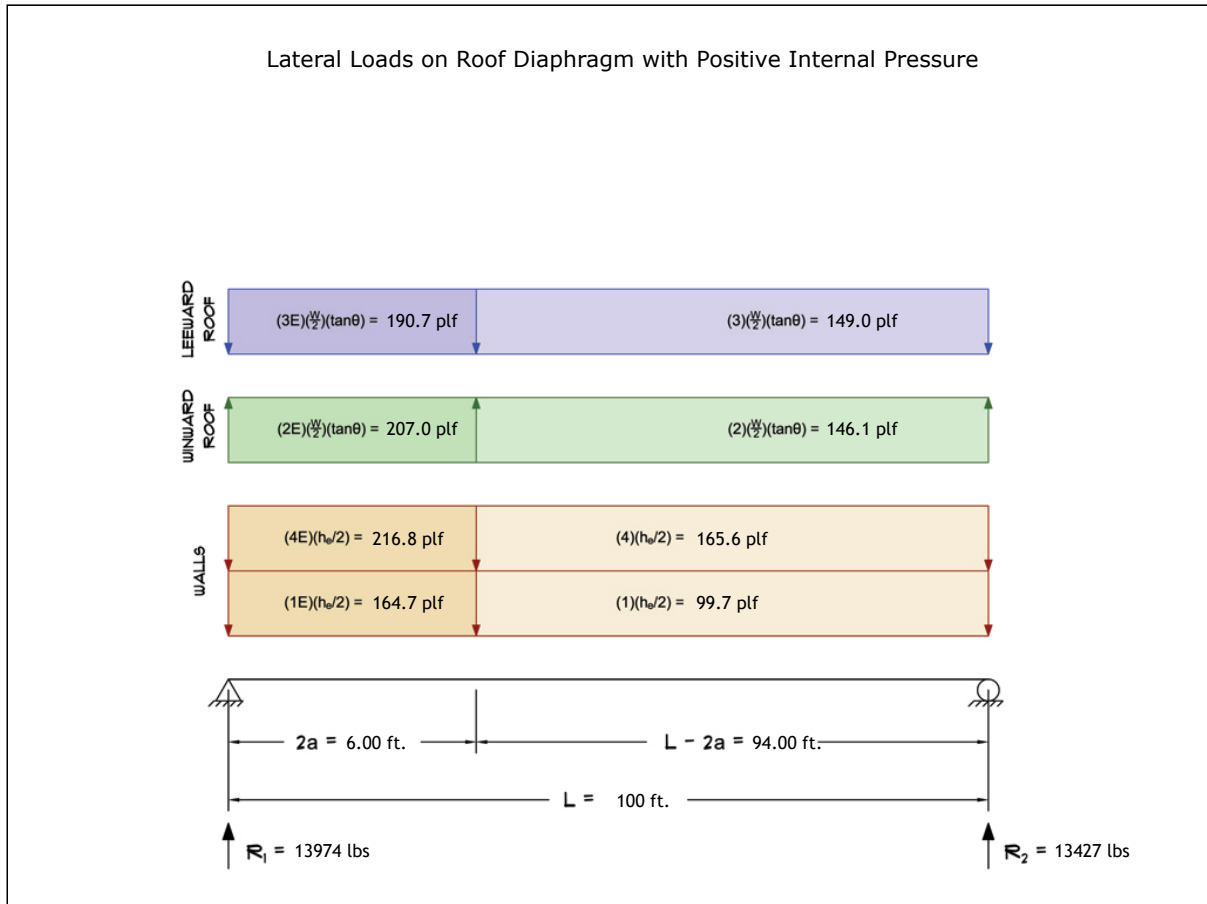

- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.  
 b) Strength design values multiplied by 0.6 to obtain ASD values.

| Wind Base Shear (ASD)             |             |            |                      |                          |                      |                      |
|-----------------------------------|-------------|------------|----------------------|--------------------------|----------------------|----------------------|
| Load Case A: Transverse Direction |             |            |                      |                          |                      |                      |
| Load Case                         | Walls (lbs) | Roof (lbs) | Roof Overhangs (lbs) | Total Lateral Load (lbs) | R <sub>1</sub> (lbs) | R <sub>2</sub> (lbs) |
| Positive Internal Pressure        | 27224       | 177        | 0                    | 27401                    | 13974                | 13427                |
| Negative Internal Pressure        | 27224       | 177        | 0                    | 27401                    | 13974                | 13427                |
| Roof Pressure = 0                 | 27224       | 0          | 0                    | 27224                    | 13940                | 13284                |
| Min. Pressures (8 psf, 16 psf)    | 12096       | 5000       | 0                    | 17096                    | 8548                 | 8548                 |


- a) Bottom half of wall neglected in tributary area calculations.  
 b) Strength design values multiplied by 0.6 to obtain ASD values.

|                               |                                                                     |                                |                             |
|-------------------------------|---------------------------------------------------------------------|--------------------------------|-----------------------------|
| Subject<br><b>Wind Loads</b>  | Customer<br><b>Summit Engineering Co</b>                            | Location<br><b>Alamosa, CO</b> | Job No.<br><b>260317MBP</b> |
| Engr.<br><b>Engineer Name</b> | <b>ENGINEERING COMPANY INC.</b>                                     |                                | Rev.<br>-                   |
| Date<br><b>4/12/2026</b>      | Street Address City, CA 99999<br>ph. (800) 000-0000 www.website.com |                                | Page<br><b>3</b>            |



This report may not be copied, reproduced or distributed without the written consent of Engineering Company Inc.

2.) Lateral Loads - Longitudinal Direction:

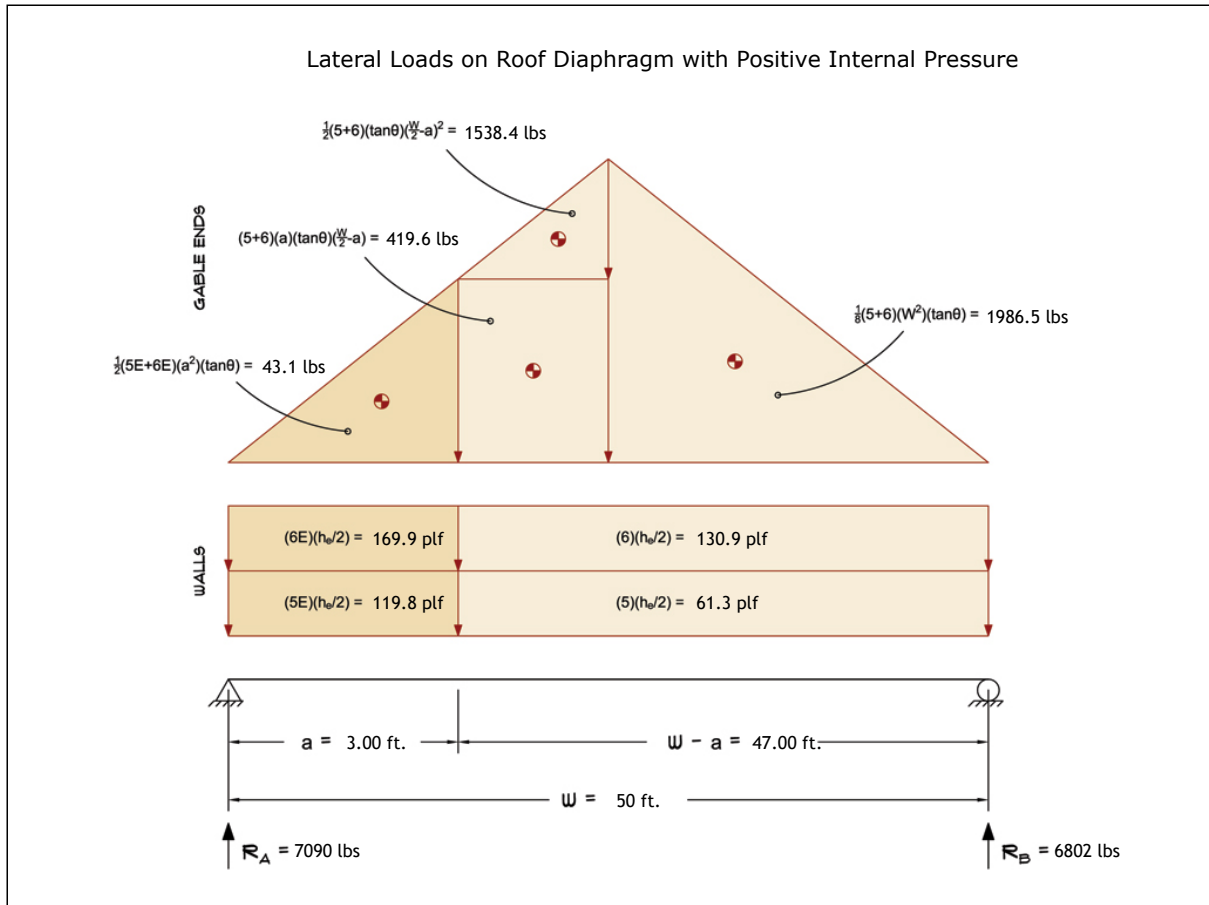

- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.
- b) Strength design values multiplied by 0.6 to obtain ASD values.
- c) Where the length of building (L) exceeds 4X the mean roof height (h), wind drag forces should additionally be considered.

| Wind Base Shear (ASD)               |             |                  |            |                          |                      |                      |
|-------------------------------------|-------------|------------------|------------|--------------------------|----------------------|----------------------|
| Load Case B: Longitudinal Direction |             |                  |            |                          |                      |                      |
| Load Case                           | Walls (lbs) | Gable Ends (lbs) | Roof (lbs) | Total Lateral Load (lbs) | R <sub>A</sub> (lbs) | R <sub>B</sub> (lbs) |
| Positive Internal Pressure          | 9904        | 3988             | 0          | 13892                    | 7090                 | 6802                 |
| Negative Internal Pressure          | 9904        | 3988             | 0          | 13892                    | 7090                 | 6802                 |
| Roof Pressure = 0                   | 9904        | 3988             | 0          | 13892                    | 7090                 | 6802                 |
| Min. Pressures (8 psf, 16 psf)      | 6048        | 2500             | 0          | 8548                     | 4274                 | 4274                 |


- a) Bottom half of wall neglected in tributary area calculations.
- b) Strength design values multiplied by 0.6 to obtain ASD values.

|            |                                                                                                        |             |           |
|------------|--------------------------------------------------------------------------------------------------------|-------------|-----------|
| Subject    | Customer                                                                                               | Location    | Job No.   |
| Wind Loads | Summit Engineering Co                                                                                  | Alamosa, CO | 260317MBP |
| Engr.      | <b>ENGINEERING COMPANY INC.</b><br>Street Address City, CA 99999<br>ph. (800) 000-0000 www.website.com |             | Rev.      |
| Date       |                                                                                                        |             | 4/12/2026 |
|            |                                                                                                        |             | Page      |
|            |                                                                                                        |             | 4         |

This report may not be copied, reproduced or distributed without the written consent of Engineering Company Inc.

Copyright © 2026

3.) Roof Truss Reactions:

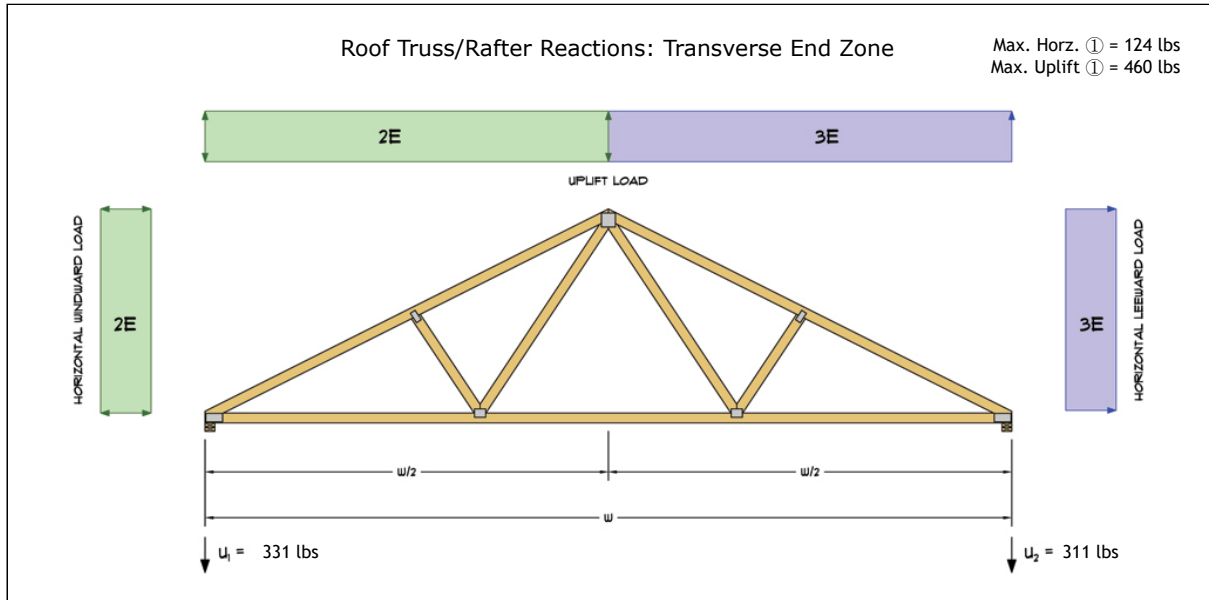

- a) Strength design values multiplied by 0.6 to obtain ASD values.
- b) Windward loads may be positive or negative depending on pitch of roof.

| Roof Truss/Rafter Reactions (ASD) |                       |                    |                  |                      |                      |
|-----------------------------------|-----------------------|--------------------|------------------|----------------------|----------------------|
| w/ Positive Internal Pressure     |                       |                    |                  |                      |                      |
| Load Case                         | Horizontal Load (lbs) | Gross Uplift (lbs) | Net Uplift (lbs) | U <sub>1</sub> (lbs) | U <sub>2</sub> (lbs) |
| Transverse Int. Zone              | -3                    | 708                | 396              | 196                  | 200                  |
| Transverse End Zone               | 16                    | 955                | 642              | 331                  | 311                  |
| Longitudinal Int. Zone            | 74                    | 785                | 472              | 280                  | 192                  |
| Longitudinal End Zone             | 124                   | 1083               | 771              | 460                  | 311                  |

- a) Gross Uplift calculations do not include any counteracting roof dead loads.
- b) Net Uplift calculations include counteracting roof dead loads multiplied by 0.6 per load case (7) ASCE 7-10.
- c) Strength design values multiplied by 0.6 to obtain ASD values for wind loads.
- d) Loads based on truss spacing calculated at 12" o/c.
- e) Negative values for horizontal load indicate load acting in windward direction (transverse load cases).
- f) Negative values for uplift indicate net downward force (zero uplift).

\*Disclaimer: The calculations produced herein are for initial design and estimating purposes only. The calculations and drawings presented do not constitute a fully engineered design. All of the potential load cases required to fully design an actual structure may not be provided by this calculator. For the design of an actual structure, a registered and licensed professional should be consulted as per IRC 2012 Sec. R802.10.2 and designed according to the minimum requirements of ASCE 7-10. The wind load calculations provided by this online tool are for educational and illustrative purposes only. Medeek Design assumes no liability or loss for any designs presented and does not guarantee fitness for use.

|         |               |                                                                     |                       |          |             |                                                                                                                                 |           |   |
|---------|---------------|---------------------------------------------------------------------|-----------------------|----------|-------------|---------------------------------------------------------------------------------------------------------------------------------|-----------|---|
| Subject | Wind Loads    | Customer                                                            | Summit Engineering Co | Location | Alamosa, CO | Job No.                                                                                                                         | 260317MBP |   |
| Engr.   | Engineer Name | <b>ENGINEERING COMPANY INC.</b>                                     |                       |          |             | <small>This report may not be copied, reproduced or distributed without the written consent of Engineering Company Inc.</small> | Rev.      | - |
| Date    | 4/12/2026     | Street Address City, CA 99999<br>ph. (800) 000-0000 www.website.com |                       |          |             |                                                                                                                                 | Page      | 5 |

