



# Wind Load Report

## 1. Site & Building Data

Roof Type:	Gable
Wind Speed (ult):	115 mph
Exposure Category:	C
Enclosure Class:	Enclosed
Building Width (W):	50 ft.
Building Length (L):	104 ft.
Eave Height (h <sub>e</sub> ):	16 ft.
Foundation Height (h <sub>f</sub> ):	0 ft.
Roof Pitch:	4 /12
Eave Overhang (OH <sub>e</sub> ):	2 ft.
Gable Overhang (OH <sub>g</sub> ):	2 ft.

## 2. Parameters & Coefficients

Topographic Factor (K <sub>zt</sub> ):	1.0
Directionality Factor (K <sub>d</sub> ):	.85
Roof Angle (θ):	18.43 deg.
Mean Roof Height (h):	20.17 ft.
Ridge Height (h <sub>r</sub> ):	24.33 ft.
Pos. Internal Pressure (+GC <sub>pi</sub> ):	+0.18
Neg. Internal Pressure (-GC <sub>pi</sub> ):	-0.18
Velocity Pressure Exp. Coeff. (K <sub>h</sub> ):	0.90 @ z=h
Velocity Pressure (q <sub>h</sub> ):	26.00 psf
End Zone Width (a):	3.00 ft.
Zone 2/2E Dist.:	25.00 ft.

## 3. Design Assumptions and Notes

Code Standard:	ASCE 7-10
Geometry:	Regular-Shaped Bldg.
Height Class:	Low-Rise Building
Notes:	

## 4. Design Loads


Top Chord Dead Load:	5 psf
Bottom Chord Dead Load:	5 psf
Truss/Rafter Spacing:	48 in. o/c

## 4. Design Wind Pressures: MWFRS Envelope Procedure

Load Case A: Transverse Direction			
Surface	GC <sub>pf</sub>	Design Pressure (psf)	
		(w/ +GC <sub>pi</sub> )	(w/ -GC <sub>pi</sub> )
1	0.52	8.75	18.11
2	-0.69	-22.62	-13.26
3	-0.47	-16.86	-7.50
4	-0.42	-15.48	-6.12
1E	0.78	15.60	24.96
2E	-1.07	-32.50	-23.14
3E	-0.67	-22.19	-12.83
4E	-0.62	-20.75	-11.39
2OH	-0.69	-17.94	
2EOH	-1.07	-27.82	
3OH	-0.47	-12.18	
3EOH	-0.67	-17.51	
2OH+W	-0.69/-0.7	-35.27	
2EOH+W	-1.07/-0.7	-45.15	



- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
- c) Design building for all wind directions, 4 load patterns per load case.
- d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
- e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
- f) Design pressures are for strength design, multiply by 0.6 for ASD.

Subject Wind Loads	Customer Robert Bertrand	Location 5800 S Poplar, Cheyenne WY	Job No. 2026D83
Engr. Cedric Green, PE	Driftwood Design 305 N 2nd St ph. 7853176354 www.driftwood3d.com		Rev. -
Date 4/19/2026	 This report may not be copied, reproduced or distributed without the written consent of Driftwood Design, LLC.		Page 1
			Copyright © 2026

### Load Case B: Longitudinal Direction


Surface	GCpf	Design Pressure (psf)	
		(w/ +GCpi)	(w/ -GCpi)
1	-0.45	-16.38	-7.02
2	-0.69	-22.62	-13.26
3	-0.37	-14.30	-4.94
4	-0.45	-16.38	-7.02
5	0.40	5.72	15.08
6	-0.29	-12.22	-2.86
1E	-0.48	-17.16	-7.80
2E	-1.07	-32.50	-23.14
3E	-0.53	-18.46	-9.10
4E	-0.48	-17.16	-7.80
5E	0.61	11.18	20.54
6E	-0.43	-15.86	-6.50
2OH	-0.69	-17.94	
2EOH	-1.07	-27.82	
3OH	-0.37	-9.62	
3EOH	-0.53	-13.78	
2EOH+W	-1.07/-0.7	-46.02	
3EOH+W	-0.53/-0.7	-31.98	




- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) External Pressure Coefficients linearly interpolated from Fig. 28.4-1 ASCE 7-10.
- c) Design building for all wind directions, 4 load patterns per load case.
- d) Total horizontal shear shall not be less than that by neglecting roof wind forces.
- e) Min. wind load for enclosed or partially enclosed bldg.: 16 psf wall, 8 psf roof.
- f) Design pressures are for strength design, multiply by 0.6 for ASD.

### Torsional Load Cases

Surface	Load Case	GCpf	Design Pressure (psf)	
			(w/ +GCpi)	(w/ -GCpi)
1T	A	-	2.19	4.53
2T	A	-	-5.65	-3.31
3T	A	-	-4.22	-1.88
4T	A	-	-3.87	-1.53
5T	B	-	1.43	3.77
6T	B	-	-3.05	-0.71

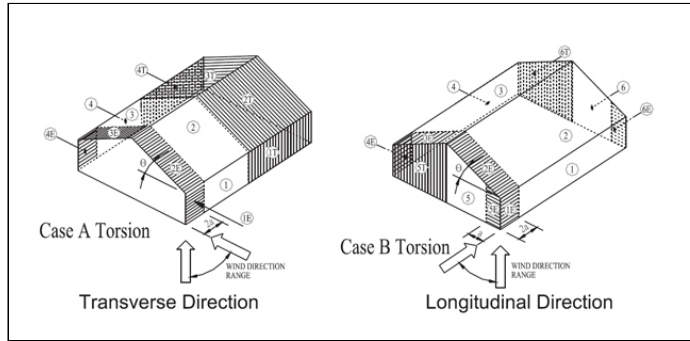


- a) (+) and (-) signs signify wind pressures acting toward & away from surfaces.
- b) Pressures designated with a "T" are 25% of full design wind pressures.
- c) Torsional loading shall apply to all 8 load patterns using the figures shown.
- d) Design pressures are for strength design, multiply by 0.6 for ASD.
- e) Torsional Design Exceptions: One story bldg. with  $h \leq 30$  ft.  
Two stories or less framed with light frame construction,  
Two stories or less with flexible diaphragms.

Subject <b>Wind Loads</b>	Customer <b>Robert Bertrand</b>	Location <b>5800 S Poplar, Cheyenne WY</b>	Job No. <b>2026D83</b>
Engr. <b>Cedric Green, PE</b>	<b>Driftwood Design</b> 305 N 2nd St ph. 7853176354 www.driftwood3d.com		Rev. -
Date <b>4/19/2026</b>			 This report may not be copied, reproduced or distributed without the written consent of Driftwood Design, LLC. Copyright © 2026

## 5. Wind Load Calculations


### 1.) Lateral Loads - Transverse Direction:

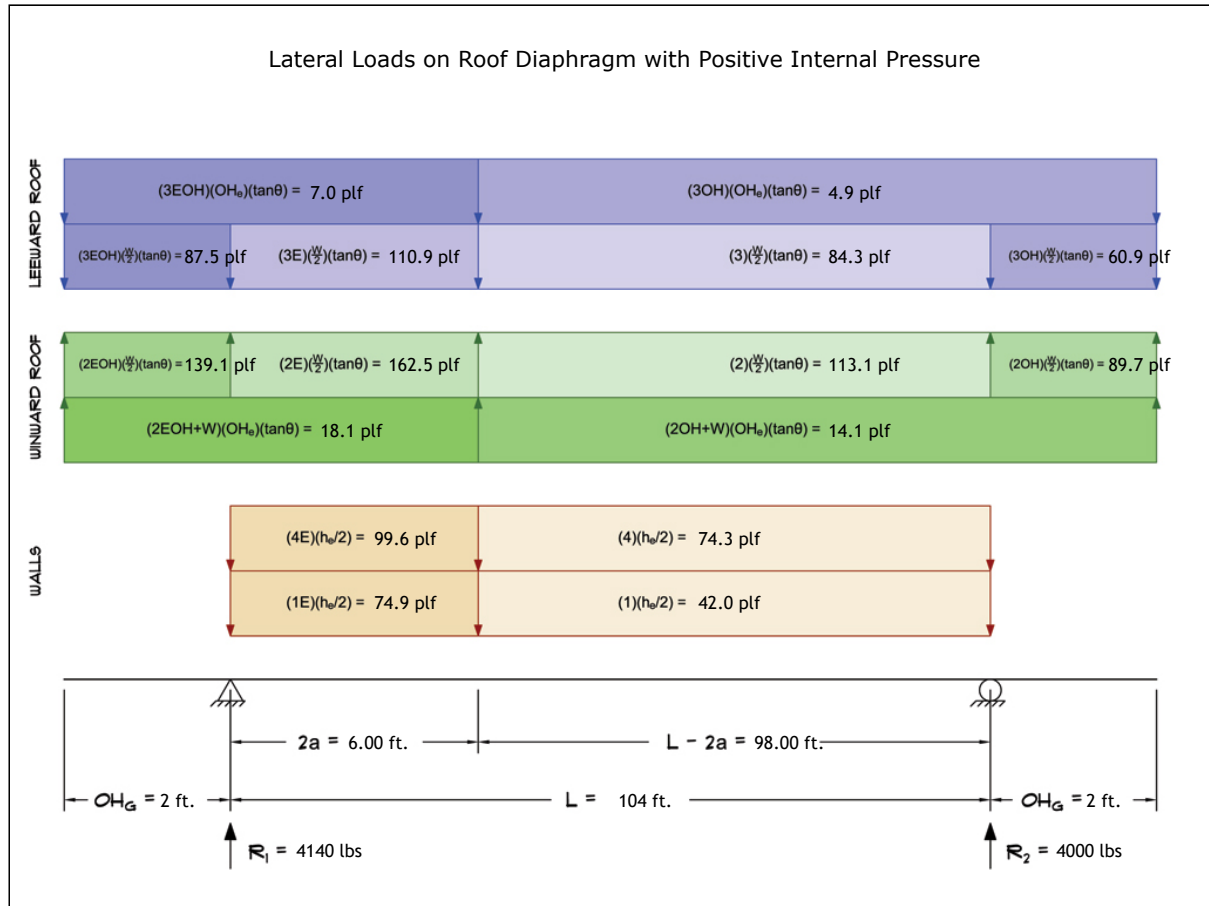


- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.  
 b) Strength design values multiplied by 0.6 to obtain ASD values.

Wind Base Shear (ASD)						
Load Case A: Transverse Direction						
Load Case	Walls (lbs)	Roof (lbs)	Roof Overhangs (lbs)	Total Lateral Load (lbs)	R <sub>1</sub> (lbs)	R <sub>2</sub> (lbs)
Positive Internal Pressure	12443	-3131	-1173	8140	4140	4000
Negative Internal Pressure	12443	-3131	-1173	8140	4140	4000
Roof Pressure = 0	12443	0	0	12443	6386	6057
Min. Pressures (8 psf, 16 psf)	7987	4160	506	12653	6326	6326

- a) Bottom half of wall neglected in tributary area calculations.  
 b) Strength design values multiplied by 0.6 to obtain ASD values.

Subject Wind Loads	Customer Robert Bertrand	Location 5800 S Poplar, Cheyenne WY	Job No. 2026D83
Engr. Cedric Green, PE	<b>Driftwood Design</b> 305 N 2nd St ph. 7853176354 www.driftwood3d.com		Rev. -
Date 4/19/2026	 This report may not be copied, reproduced or distributed without the written consent of Driftwood Design, LLC. Copyright © 2026		Page 3

2.) Lateral Loads - Longitudinal Direction:

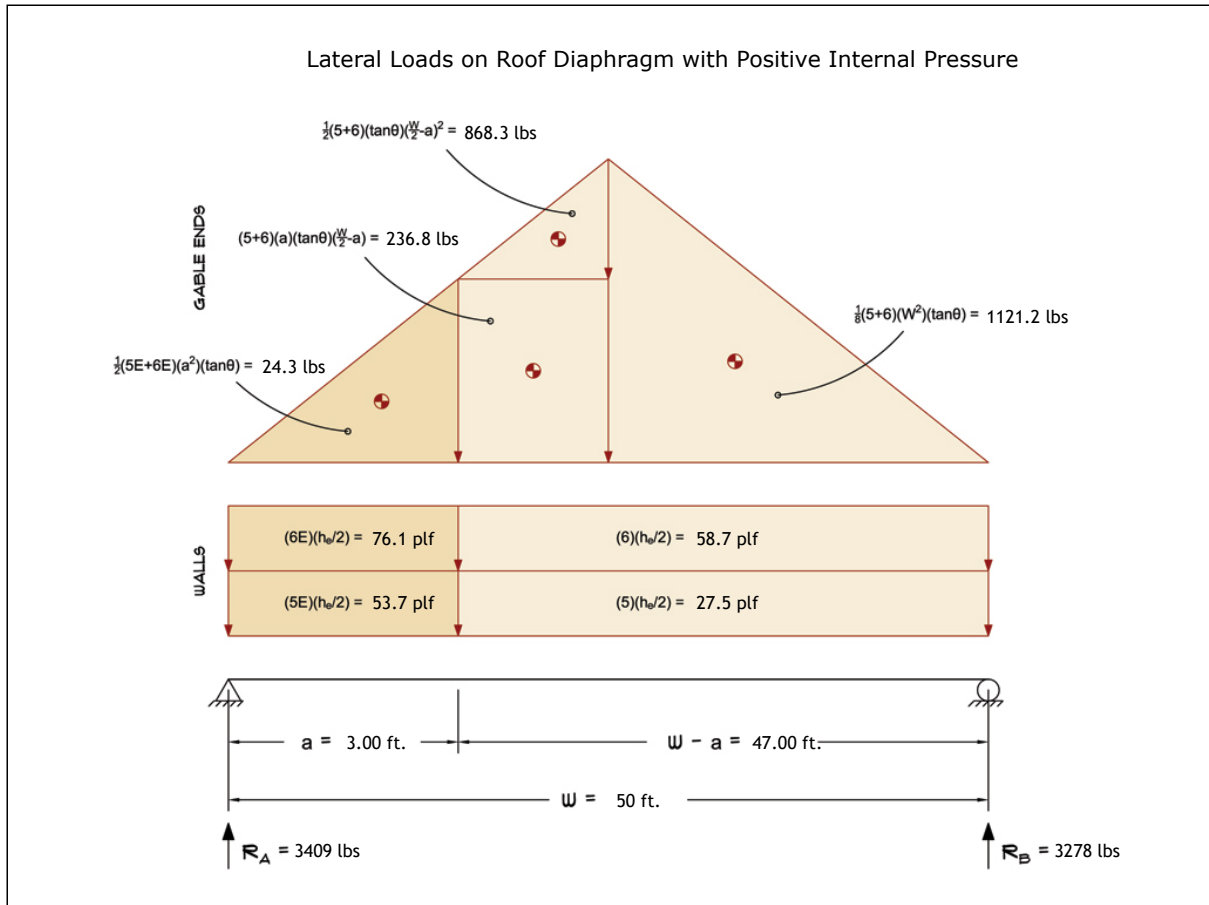

- a) (-) signs signify wind lateral forces acting opposite to the direction of the arrows shown.
- b) Strength design values multiplied by 0.6 to obtain ASD values.
- c) Where the length of building (L) exceeds 4X the mean roof height (h), wind drag forces should additionally be considered.


Wind Base Shear (ASD)						
Load Case B: Longitudinal Direction						
Load Case	Walls (lbs)	Gable Ends (lbs)	Roof (lbs)	Total Lateral Load (lbs)	R <sub>A</sub> (lbs)	R <sub>B</sub> (lbs)
Positive Internal Pressure	4437	2251	0	6687	3409	3278
Negative Internal Pressure	4437	2251	0	6687	3409	3278
Roof Pressure = 0	4437	2251	0	6687	3409	3278
Min. Pressures (8 psf, 16 psf)	3840	2000	0	5840	2920	2920

- a) Bottom half of wall neglected in tributary area calculations.
- b) Strength design values multiplied by 0.6 to obtain ASD values.

Subject <b>Wind Loads</b>	Customer <b>Robert Bertrand</b>	Location <b>5800 S Poplar, Cheyenne WY</b>	Job No. <b>2026D83</b>
Engr. <b>Cedric Green, PE</b>	<b>DRIFTWOOD DESIGN</b> 305 N 2nd St ph. 7853176354 www.driftwood3d.com		Rev. -
Date <b>4/19/2026</b>			Page <b>4</b>

This report may not be copied, reproduced or distributed without the written consent of Driftwood Design, LLC  
Copyright © 2026

3.) Roof Truss Reactions:

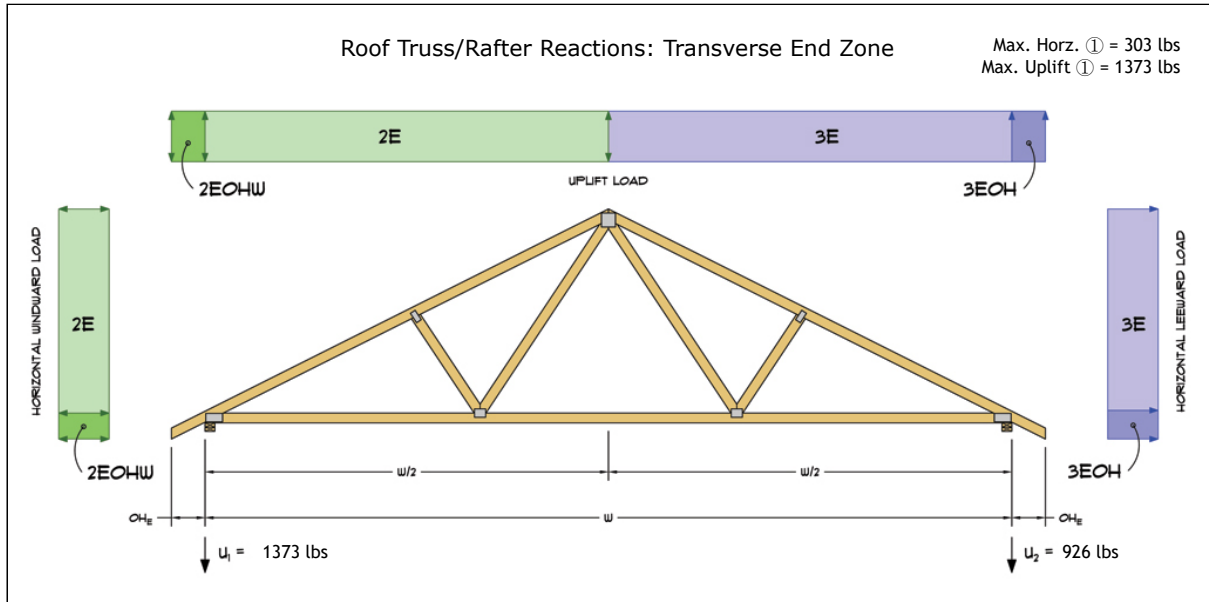


- a) Strength design values multiplied by 0.6 to obtain ASD values.
- b) Windward loads may be positive or negative depending on pitch of roof.

Roof Truss/Rafter Reactions (ASD)					
w/ Positive Internal Pressure					
Load Case	Horizontal Load (lbs)	Gross Uplift (lbs)	Net Uplift (lbs)	U <sub>1</sub> (lbs)	U <sub>2</sub> (lbs)
Transverse Int. Zone	152	2597	1314	801	513
Transverse End Zone	251	3582	2299	1373	926
Longitudinal Int. Zone	180	2347	1064	678	387
Longitudinal End Zone	303	3257	1974	1233	741

- a) Gross Uplift calculations do not include any counteracting roof dead loads.
- b) Net Uplift calculations include counteracting roof dead loads multiplied by 0.6 per load case (7) ASCE 7-10.
- c) Strength design values multiplied by 0.6 to obtain ASD values for wind loads.
- d) Loads based on truss spacing calculated at 48" o/c.
- e) Negative values for horizontal load indicate load acting in windward direction (transverse load cases).
- f) Negative values for uplift indicate net downward force (zero uplift).

\*Disclaimer: The calculations produced herein are for initial design and estimating purposes only. The calculations and drawings presented do not constitute a fully engineered design. All of the potential load cases required to fully design an actual structure may not be provided by this calculator. For the design of an actual structure, a registered and licensed professional should be consulted as per IRC 2012 Sec. R802.10.2 and designed according to the minimum requirements of ASCE 7-10. The wind load calculations provided by this online tool are for educational and illustrative purposes only. Medeek Design assumes no liability or loss for any designs presented and does not guarantee fitness for use.

Subject <b>Wind Loads</b>	Customer <b>Robert Bertrand</b>	Location <b>5800 S Poplar, Cheyenne WY</b>	Job No. <b>2026D83</b>
Engr. <b>Cedric Green, PE</b>	<b>Driftwood Design</b> 305 N 2nd St ph. 7853176354 www.driftwood3d.com		Rev. -
Date <b>4/19/2026</b>			 DRIFTWOOD DESIGN