

### GENERAL NOTES:

- ALL DOOR AND WINDOW HEADERS TO BE 3-2×12 UNLESS OTHERWISE NOTED.
- SEE OWNER FOR LOCATION OF HOSE BIBS.
- HOSE BIBS TO HAVE APPROVED BACK-FLOW PROTECTION. INTERIOR WALLS FRAMED WITH 2X4 @ 16 O/C
- UNLESS OTHERWISE NOTED.
- WATER HEATER SHALL BE LOCATED IN BASEMENTAS REQUIRED AND COMPLY WITH ALL LOCAL CODES. HYAC SPECIFICATIONS, DISTRIBUTION AND LOAD CALCULATIONS
- SHALL BE PROVIDED AS A SUPPLEMENT TO THIS PLANSET BY HVAC CONTRACTOR. HVAC SYSTEM AND INSULATION (PER PLANSET) WILL COMPLY WITH LOCAL CODES.
- CAULK & COUNTER FLASH ALL EXT. OPENINGS: WINDOWS, DOORS, VENTS. ETC...
- GAP ALL SHEATHING AS PER MANUF. SPECS. INSTALL
- H-CLIPS ON 1/16" OSB ROOF SHEATHING.
  CONCRETE MIX, MINIMUM COMPRESSIVE STRENGTH 3000 PSI.
  USE ICE AND WATER SHIELD CONSISTING OF ONE LAYER OF
- USE ICE AND WATER SHIELD CONSISTING OF ONE LATER OF NO.40 COATED ROOFING OR COATED GLASS BASE 24" INSIDE EXT. WALL LINE OF THE BUILDING.
  WHERE LOCAL WATER PRESSURE IS IN EXCESS OF 80 PSI, AN APPROVED PRESSURE REGULATOR PRECEDED BY AN ADEQUATE STRAINER SHALL BE INSTALLED.
  RAISE DOORS UP 3/4" FOR TILE OR HARDWOOD FLOOR.
- 13. LIVE LOADS:
  - ROOF. .30 LBS/SQFT
  - .40 LBS/SQFT FLOORS. STAIRS.. ..100 LBS/SQFT
  - ..100 MPH WIND. SEISMIC ZONE .... ..A,B,C,D
- EARTH PRESSURE ... 30 LBS/CF ASSUMED SOIL BEARING CAPACITY IS 1500 LBS/SQFT. EXTEND ALL FOOTINGS DOWN TO UNDISTURBED SOIL OF THE SPECIFIED STRENGTH WITH A MIN. DEPTH OF 1'-6" BELOW GRADE OR AS REQUIRED BY LOCAL BUILDING CODE, BASED
- ON LOCAL FROST LINE DEPTH. PRE-FABRICATED TRUSSED MEMBERS TO BE DESIGNED BY APPLICABLE STATE LICENSED ENGINEER IN ACCORDANCE WITH REQUIREMENTS SHOWN IN PLANSET. CONTRACTOR SHALL
- VERIFY AS-FRAMED DIMENSIONS AND CONDITIONS PRIOR TO TRUSS FABRICATION AND COORDINATE AS REQUIRED. ALL TRUSS ENGINEERING DATA SHALL BE MADE AVAILABLE
- TO THE BUILDING OFFICIAL UPON REQUEST AND BECOMES A PART OF THIS PLANSET. 17. CONTRACTOR TO VERIFY SIZE AND LOCATION OF ALL OPENINGS IN FLOOR, ROOF AND WALLS AND COORDINATE WITH PLUMBING, ELECTRICAL AND MECHANICAL WORK.
- PROVIDE WASHERS ON ALL BOLTED CONNECTIONS.
  ALL SIMPSON STRONG TIE CONNECTORS AND HANGERS
  TO BE INSTALLED WITH STRICT ACCORDANCE TO MANUF.
- INSTALLATION REQS. SEE INSTALLER GUIDE: S-INSTALL@9. 20. LUMBER SPECIFICATIONS:
- HF/DF NO. 2 FOR JOISTS, RAFTERS, LIGHT FRAMING PLATES AND BRACING.
- DF NO. 1 FOR POSTS AND BEAMS HF/DF "STUD" FOR STUD WALL FRAMING
  REINFORCING STEEL (REBAR) ASTM A-615 GRADE 60.
- CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS, MATERIALS AND DIMENSIONS IN THE FIELD.

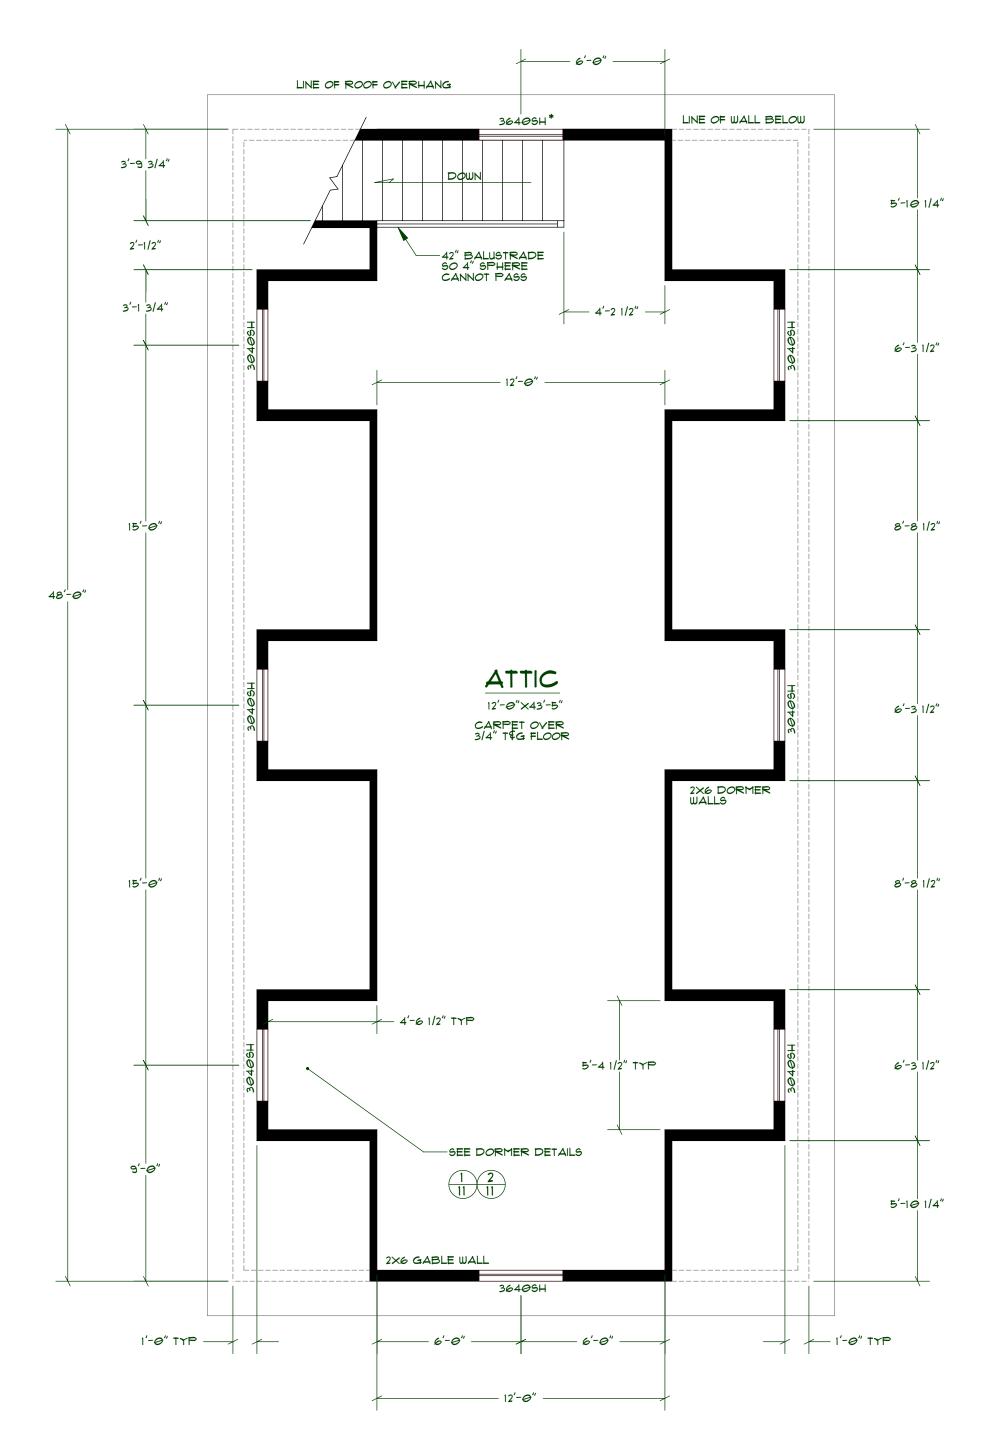

# ATTIC FLOOR PLAN

SCALE: 1/4"=1'-0"

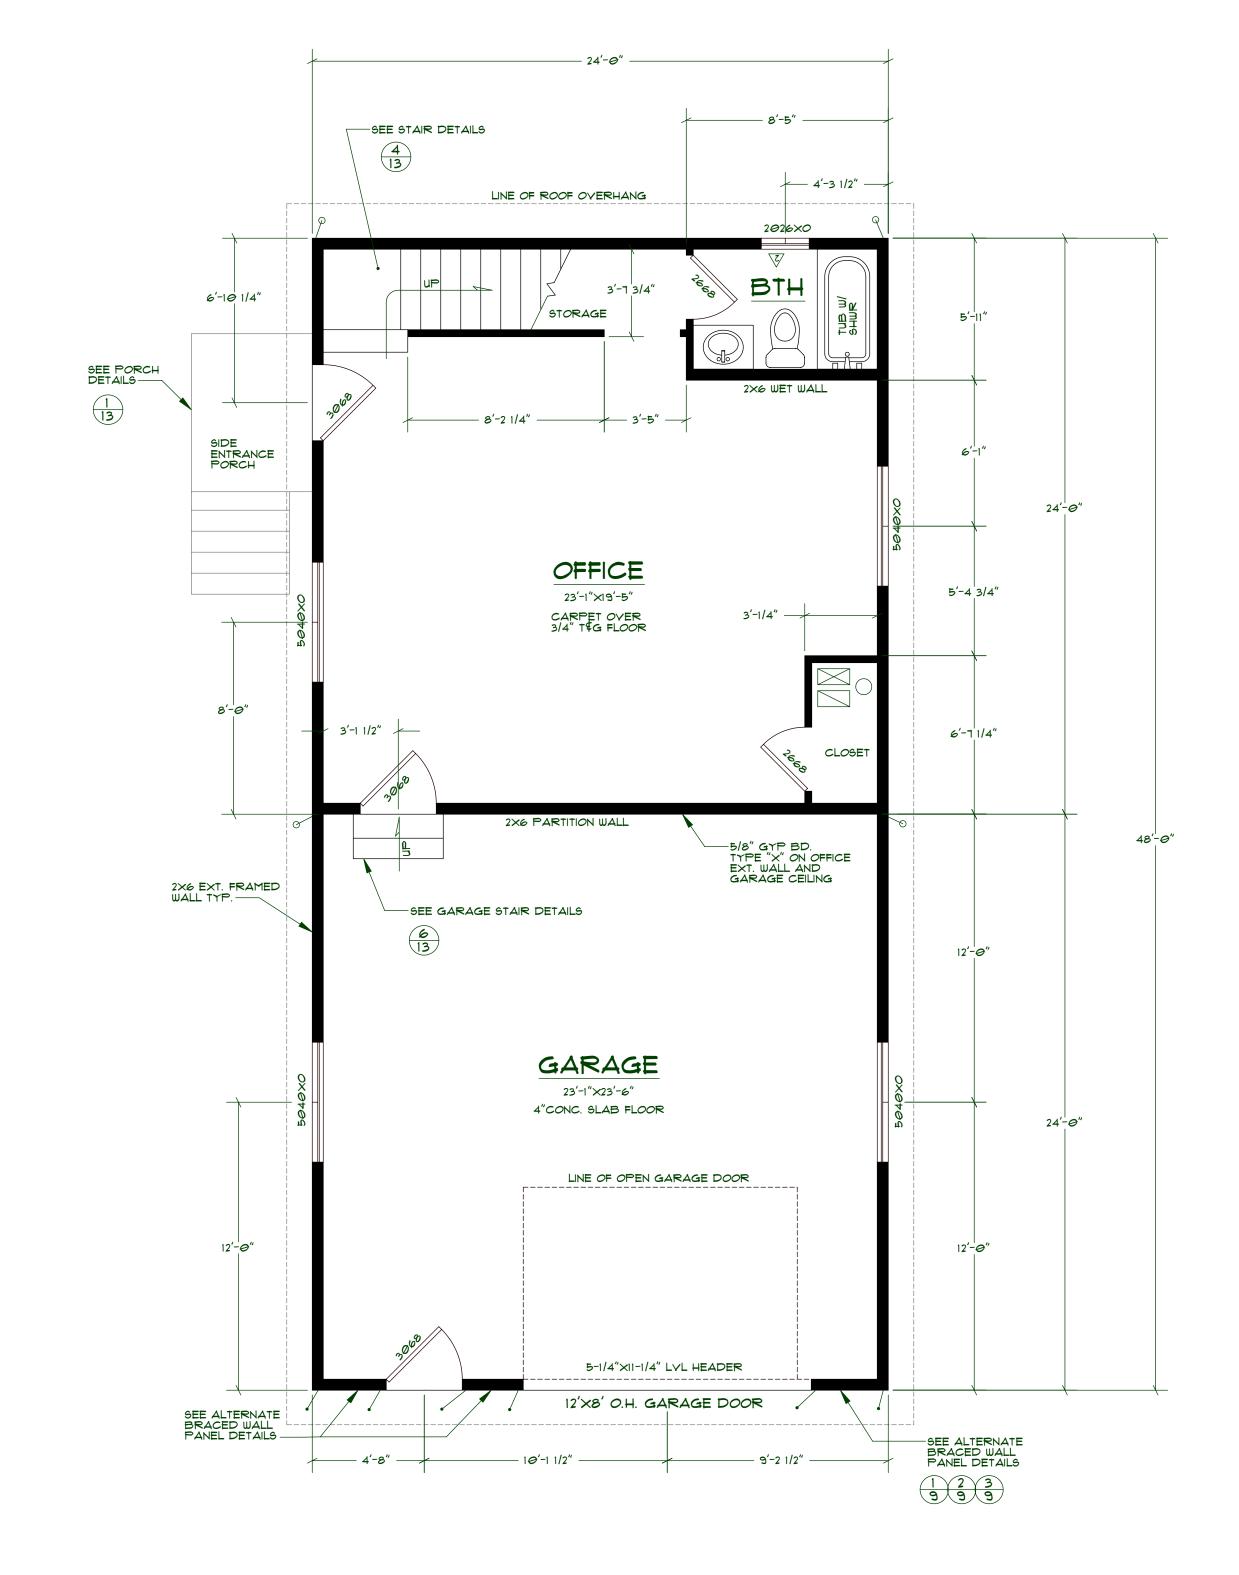

# MAIN FLOOR PLAN

TYP. AS SHOWN.

SCALE: 1/4"=1'-0"

# HOLDOWNS:

- SHOWS LOCATION OF SST STHD14 HOLDOWNS. INSTALL AS PER MANUF. SPECS.
- SHOWS LOCATION OF SST STHD14RJ HOLDOWNS. INSTALL AS PER MANUF. SPECS.

IT IS IMPORTANT FOR THE GENERAL CONTRACTOR
TO UNDERSTANT THAT IT IS HIS/HER RESPONSIBILITY
TO BE SURE THIS PROJECT IS CONSTRUCTED IN FULL
COMPLIANCE WITH ALL STATE AND LOCAL CODES
AND ORDINANCES. THE PLANS ARE NOT ALL
INCLUSIVE OF ALL MINIMUM CODES AND ORDINANCES.
THIS FACT DOES NOT RELIEVE THE CONTRACTOR
FROM COMPLIANCE WITH ALL MINIMUM STANDARDS.
NO OMISSION FROM THESE PLANS GIVES PERMISSION
FOR VIOLATION OF ANY CODE OR ORDINANCE. NO
APPROVAL EVER GRANTS PERMISSION TO VIOLATE
ANY CODE OR CITY ORDINANCE.

ATTENTION !

STATE BUILDING CODES: 2003 IRC, 2003 IMC, 2003 IPC, 2002 NEC, AND 2003 IECC (MEC) AND ALL WASHINGTON STATE AMENDED CODES. FOR STRUCTURAL ENG. USE 2003 IBC. THE GREATEST EFFORT HAS BEEN MADE TO DRAW THESE PLANS WITHOUT ERROR. HOWEVER THERE IS NO GUARANTEE THAT THESE PLANS ARE WITHOUT ERROR. THE ARCHITECT & DRAFTSMAN ARE TO BE HELD HARMLESS OF ANY FINANCIAL LIABILITY RESULTING FROM ERRORS IN THESE PLANS. ANY ONE USING THESE PLANS FOR CONSTRUCTION OF THIS BUILDING ACCEPT FULL RESPONSIBILITY. (CHECK PLANS CAREFULLY BEFORE AND DURING CONSTRUCTION.)

FLOOR PLAN DIMENSIONS ARE TO FACE OF FRAMING OR CENTERLINE OF OPENINGS,

DESIGN EDEEK

82

© \ 4 m

SHEET